

PYRO-SAFE® Novasit BM

Installation instructions

Mixed penetration sealing system made of special mortar for electrical cables and lines of all types, electrical installation pipes, combustible/non-combustible pipes and further services.

Fire resistance class maximum EI 120 compliant with EN 13501-2 in accordance with ETA-16/0132.





PYRO-SAFE® Novasit BM

Table of contents

Topic	Page
1. Preliminary remarks / Overview.....	3
1.1 Target group	3
1.2 Use of the instructions.....	3
1.3 Safety instructions.....	3
1.4 Scope	4
1.5 Structural elements	4
1.6 Fire resistance classes for wall and floor partition	5
1.7 Field of application (Dimensions)	9
2. Allowed services	10
2.1 Cables / cable bundles / cable supports / Electrical installation conduits / PE lines	10
2.2 Combustible pipes.....	10
2.3 Multilayer pipes „HENCO pipes“	11
2.4 Non-combustible pipes.....	11
2.5 Further allowed services	12
2.6 PYRO-SAFE® CT Cable Tube (for retrofitting).....	13
3. Spacing requirements	14
4. Used products	16
5. Regulations and variants	17
5.1 Rules over the first cable/pipe support.....	18
6. Fire protection measures	19
6.1 Cables / cable bundles / cable trays	19
6.2 Electrical installation conduits (EIC) single or bundled	21
6.3 Electrical installation conduits (EIC) single - application with mineral-fibre mats	22
6.4 PE lines “speed pipes” (for glass fibre cables and micro cables).....	23
6.5 Combustible pipes.....	24
6.6 Multilayer pipes „HENCO pipes“	25
6.7 Non-combustible pipes.....	26
6.7.1 Section insulation made of lamella mat „KLIMAROCK“ or mineral fibre shell „Conlit 150U“	26
6.7.2 Section insulation made of FEF „Armaflex Protect“	28
6.7.3 Section insulation made of FEF „NH/Armaflex“	29
6.8 Further allowed services	30
6.8.1 HVAC split line combinations	30
6.8.2 Double solar pipes „NanoSUN2“.....	31
6.8.3 “HANSA FLEX” hydraulic hoses with wire mesh insert	32
6.9 Retrofitting with „PYRO-SAFE® CT“ Cable Tube	33
7. Installation steps	34
8. Declaration of Performance	36

PYRO-SAFE® Novasit BM

1. Preliminary remarks / Overview

1.1 Target group





- The installation instructions are intended solely for personnel trained in fire protection.

1.2 Use of the instructions



- Read through these installation instructions entirely before beginning work. Pay particular attention to the following safety instructions.
- The authorisation holder assumes no liability for damage caused by failure to comply with these instructions.
- Figures appear as examples only. Installation results may differ in appearance.
- Unless otherwise indicated, all lengths are in millimeters
- All information in this document corresponds to the current state of the art or the valid standard version at the time of preparation. Upon request, svt will gladly provide the relevant statutory and technical framework conditions or manufacturer's specifications for each individual case.
- © Copyright svt Unternehmensgruppe, Gluesinger Strasse 86 Seevetal Germany
- PYRO-SAFE® is a registered trademark of the svt group.

1.3 Safety instructions

- The safety data sheets must be used for advice when processing the fire protection compounds.
- Personal protective equipment:

	Wear protective clothing and non-slip shoes.
	Use protective goggles, wrap-around glasses.
	In case of short-term or low-level exposure: P2 particle filter. In case of intensive or long-term exposure: use self-contained breathing apparatus. Only use respirators that comply with international/national standards.
	Use chemicals-resistant protective gloves. Recommended material: butyl rubber, nitrile rubber, fluoro rubber, PVC.

Safety instructions for the installation of floor penetration seals

	The area below the floor penetration seal must be cordoned off while work on the penetration seal is underway (warning tape, or sign: danger - falling objects; keep off this area; sealing work underway in the floor above!)
	The company that is commissioned to install the floor penetration seals shall provide the client with written information (to be passed on to the owner or his authorised representative), pointing out that fire-resistant penetration seals in floors must be provided on site with adequate protection (e.g. barriers), or covered with grating to prevent them from being walked on after installation.



PYRO-SAFE® Novasit BM

1.4 Scope

The PYRO-SAFE® Novasit BM mixed penetration sealing system with mortar in wall and floor openings with PYRO-SAFE® NOVASIT BM belong to the “mortar” product type in accordance with ETAG 026-2 and is assessed and evaluated accordingly. The fire protection mortar PYRO-SAFE® NOVASIT BM is classified as a product for use in penetration seals in accordance with ETA-16/0132.

Reaction to fire

PYRO-SAFE® NOVASIT BM is classified as A1 in accordance with EN 13501-1.

Fire resistance

PYRO-SAFE® Novasit BM complies with requirements of class EI 120 for cables, EI 120-U/U resp. EI 120-U/C for plastic pipes and EI 120-C/U for metal pipes in accordance with EN 13501-2.

The pipe end configuration -U/U covers also all other possible endings (C/U, U/C and C/C) in accordance with EN 13501-2.

The pipe end configuration -U/C also covers the configuration -C/C in accordance with EN 13501-2. The -U/C configuration is also valid for -C/U and -C/C in accordance with EN 13501-2.

When installed in walls or floors with a lower fire resistance duration, the fire resistance duration of the penetration seal is also reduced to that of the fire resistance class of the wall or floor.

Release of dangerous substances

None

Durability and serviceability

The fire protection mortar „PYRO-SAFE® NOVASIT BM“ fulfils the type Z2 in accordance with EOTA TR 024.

PYRO-SAFE® Novasit BM can be subjected to the conditions of inside rooms with and without exposure to moisture, without substantial changes to the fire protection characteristics being expected.

1.5 Structural elements

Solid walls

Made of masonry, concrete, reinforced concrete, porous concrete, ceramic bricks, hollow bricks or air bricks with a density $\geq 600 \text{ kg/m}^3$.

The walls must be correspondingly rated for the required fire resistance class in accordance with EN 13501-2.

Solid floors

Made of concrete, reinforced concrete with a density of $\geq 1700 \text{ kg/m}^3$.

The walls must be correspondingly rated for the required fire resistance class in accordance with EN 13501-2.



PYRO-SAFE® Novasit BM

1.6 Fire resistance classes for wall and floor partition

Fire resistance classes					
	Measures	Wall		Floor	
		Fire resistance class	Source*	Fire resistance class	Source*
Cables, cable bundles and cable trays without protective measures					
Cables Ø ≤ 32 mm	-	EI 120	1, 2, 5	EI 120	3, 5
Single-core-non-sheathed cables (Wires, Ø ≤ 24 mm)	-	EI 120	1	EI 120	1
Cable bundles Ø ≤ 60 mm	-	EI 120	1	EI 120	1
Cable bundles Ø ≤ 100 mm	-	EI 90 / E 120	2	EI 60 / E 120	3
Cables, cable bundles and cable trays with 240 mm seal thickness					
Cables Ø ≤ 50 mm	240 mm seal thickness	EI 120	1	EI 90 / E 120	1
Cables Ø ≤ 80 mm	240 mm seal thickness	EI 90 / E 120	1	EI 90 / E 120	1
Cable bundles Ø ≤ 100 mm	240 mm seal thickness	EI 120	1	EI 120	1
Cables, cable bundles and cable trays with fire protection wrap „PYRO-SAFE® DG-CR 1.5“					
Cables Ø ≤ 50 mm	2x 2-layer, 125 mm	EI 120	5	EI 120	5
Cables Ø ≤ 80 mm	2x 2-layer, 125 mm	EI 90 / E 120	5	EI 120	5
	2x 2-layer, 150 mm	EI 120	5	EI 120	5
Cable bundles Ø ≤ 100 mm	2x 1-layer, 125 mm	EI 120	1, 2, 5	EI 120	1, 3, 5
Electrical installation conduit with fire protection wrap „PYRO-SAFE® DG-CR 1.5“ – Wrap width 125 mm					
Conduits Ø ≤ 32 mm	2x 1-layer	EI 120 U/U	5	EI 120 U/U	5
Conduits Ø ≤ 63 mm	2x 2-layer	EI 120 U/U	5	EI 120 U/U	5
Conduits Ø ≤ 100 mm	2x 3-layer + lamella mat ≥ 500 mm x ≥ 30 mm	-		EI 120 U/U	5
Conduit-bundles Ø ≤ 100 mm (single conduits Ø ≤ 32 mm)	2x 2-layer	EI 120 U/U	5	EI 120 U/U	5
Electrical installation conduit with non-combustible insulation made of mineral-fibre „lamella mat“					
Conduits Ø ≤ 63 mm	Lamella mat ≥ 500 mm x ≥ 30 mm	EI 120 U/U	5	EI 120 U/U	5
“speed pipe“ single or bundled, with or w/o glass fibre or micro cable; with fire protection wrap “PYRO-SAFE® DG-CR 1.5“ – Wrap width 125 mm					
max. 24 pcs.; outside pipe-Ø ≤ 7 mm max. 7 pcs.; outside pipe-Ø ≤ 10 mm max. 5 pcs.; outside pipe-Ø ≤ 12 mm	Wall 2x, Floor 1x 1-layer	EI 120 U/U	1	EI 120 U/U	1
Non-combustible pipes made of copper with non-combustible insulation made of mineral-fibre „lamella mat”					
Outside pipe-Ø ≤ 15,0 mm	≥ 250 mm x ≥ 20 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 28,0 mm	≥ 500 mm x ≥ 20 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 42,0 mm	≥ 500 mm x ≥ 30 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 54,0 mm	≥ 500 mm x ≥ 40 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 88,9 mm	≥ 750 mm x ≥ 60 mm	EI 120 C/U	1	EI 120 C/U	1
Non-combustible pipes made of steel, stainless steel or cast iron with non-combustible insulation made of mineral-fibre „lamella mat”					
Outside pipe-Ø ≤ 15,0 mm	≥ 250 mm x ≥ 20 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 28,0 mm	≥ 500 mm x ≥ 20 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 42,0 mm	≥ 500 mm x ≥ 30 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 114,3 mm	≥ 500 mm x ≥ 40 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 168,3 mm	≥ 1000 mm x ≥ 40 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 323,9 mm	≥ 1000 mm x ≥ 40 mm + lamella mat ≥ 500 mm x ≥ 30 mm	EI 120 C/U	1	EI 120 C/U	1

*Classification report No.: 1 → 1883.1/14/Z00NP, 2 → KB 3.2/11-104-1, 3 → KB 3.2/11-103-1, 4 → 01883.2/14/Z00NP, 5 → 02761.3/16/Z00NP

PYRO-SAFE® Novasit BM

Fire resistance classes					
	Measures	Wall		Floor	
		Fire resistance class	Source*	Fire resistance class	Source*
Non-combustible pipes made of copper with non-combustible insulation „Conlit 150U“					
Outside pipe-Ø ≤ 15,0 mm	≥ 250 mm x ≥ 22,5 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 28,0 mm	≥ 500 mm x ≥ 26 mm	EI 120 C/U	1	-	1
Outside pipe-Ø ≤ 42,0 mm	≥ 500 mm x ≥ 19 mm	-	1	EI 120 C/U	1
Outside pipe-Ø ≤ 54,0 mm	≥ 500 mm x ≥ 38 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 108,0 mm	≥ 1000 mm x ≥ 36 mm	EI 120 C/U	1	EI 120 C/U	1
Non-combustible pipes made of steel, stainless steel or cast iron with non-combustible insulation „Conlit 150U“					
Outside pipe-Ø ≤ 15,0 mm	≥ 250 mm x ≥ 22,5 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 28,0 mm	≥ 500 mm x ≥ 26 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 42,0 mm	≥ 500 mm x ≥ 19 mm	-	-	EI 120 C/U	1
Outside pipe-Ø ≤ 54,0 mm	≥ 500 mm x ≥ 38 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 114,3 mm	≥ 750 mm x ≥ 33 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 168,3 mm	≥ 1000 mm x ≥ 40 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 219,1 mm	≥ 1000 mm x ≥ 40 mm + lamella mat ≥ 500 mm x ≥ 40 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 323,9 mm	≥ 1000 mm x ≥ 40 mm + lamella mat ≥ 500 mm x ≥ 40 mm	EI 120 C/U	1	EI 90 / E 120 C/U	1
Non-combustible pipes made of copper with combustible insulation „Armaflex Protect“					
Outside pipe-Ø ≤ 28,0 mm	≥ 250 mm x 25 mm	EI 120 C/U	1	EI 120 C/U	1
	≥ 500 mm x 26 mm - 51 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 88,9 mm	≥ 500 mm x 25 mm	EI 120 C/U	1	EI 120 C/U	1
	≥ 1000 mm x 26 mm - 51 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 108,0 mm	≥ 1000 mm x 26 mm - 52 mm + lamella mat ≥ 500 mm x ≥ 40 mm	EI 120 C/U	1	EI 120 C/U	1
Non-combustible pipes made of steel, stainless steel or cast iron with combustible insulation „Armaflex Protect“					
Outside pipe-Ø ≤ 28,0 mm	≥ 250 mm x 25 mm	EI 120 C/U	1	EI 120 C/U	1
	≥ 500 mm x 26 mm - 51 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 88,9 mm	≥ 500 mm x 25 mm	EI 120 C/U	1	EI 120 C/U	1
	≥ 1000 mm x 26 mm - 51 mm	EI 120 C/U	1	EI 120 C/U	1
Outside pipe-Ø ≤ 170,0 mm	≥ 1000 mm x 52 mm	EI 120 C/U	1	-	-
	≥ 1000 mm x 26 mm - 52 mm + lamella mat ≥ 500 mm x ≥ 40 mm	EI 120 C/U	1	EI 120 C/U	1
Non-combustible pipes made of copper with combustible insulation „NH/Armaflex“ with fire protection wrap „PYRO-SAFE® DG-CR 1.5“ – Wrap width 125 mm					
Outside pipe-Ø ≤ 54,0 mm / 76,0 mm (floor)	2x 2-layer	EI 120 C/U	5	EI 120 C/U	5
Outside pipe-Ø ≤ 88,9 mm	2x 2-layer + lamella mat ≥ 500 mm x ≥ 40 mm	EI 120 C/U	5	EI 120 C/U	5
Outside pipe-Ø ≤ 108,0 mm	2x 2-layer + lamella mat ≥ 750 mm x ≥ 40 mm	EI 120 C/U	5	EI 120 C/U	5
Non-combustible pipes made of steel, stainless steel or cast iron with combustible insulation „NH/Armaflex“ with fire protection wrap „PYRO-SAFE® DG-CR 1.5“ – Wrap width 125 mm					
Outside pipe-Ø ≤ 168,3 mm	2x 2-layer + lamella mat ≥ 500 mm x ≥ 40 mm	EI 120 C/U	5	EI 120 C/U	5

*Classification report No.: 1 → 1883.1/14/Z00NP, 2 → KB 3.2/11-104-1, 3 → KB 3.2/11-103-1, 4 → 01883.2/14/Z00NP, 5 → 02761.3/16/Z00NP



PYRO-SAFE® Novasit BM

Fire resistance classes					
	Measures	Wall		Floor	
		Fire resistance class	Source*	Fire resistance class	Source*
Multilayer pipes „HENCO pipes“ with non-combustible insulation made of mineral-fibre „lamella mat”					
Outside pipe-Ø ≤ 12,0 mm, wall thickness 1,6 mm	Lamella mat ≥ 250 mm x ≥ 20 mm	EI 120 U/C	5	EI 120 U/C	5
Outside pipe-Ø ≤ 32,0 mm, wall thickness 3,0 mm		EI 120 U/C	5	EI 120 U/C	5
Outside pipe-Ø ≤ 63,0 mm, wall thickness 4,5 mm	Lamella mat ≥ 250 mm x ≥ 30 mm	EI 120 U/C	5	EI 120 U/C	5
Multilayer pipes „HENCO pipes“ with PE-foam (PEF) insulation and intumescent wrap “PYRO-SAFE® DG-CR BS” – Wrap width 100 mm					
Outside pipe-Ø ≤ 14,0 mm, wall thickn. 2,0 mm, PEF 6 mm	2x 1-layer + lamella mat ≥ 250 mm x ≥ 20 mm	EI 120 U/C	5	EI 120 U/C	5
Outside pipe-Ø ≤ 26,0 mm, wall thickn. 3,0 mm, PEF 6 - 13 mm		EI 120 U/C	5	EI 120 U/C	5
Outside pipe-Ø ≤ 32,0 mm, wall thickn. 2,0 mm, PEF 6 - 10 mm		EI 120 U/C	5	EI 120 U/C	5
Combustible pipes with/without 5 mm PE-foam acoustic insulation made of PVC-U, PVC-C , PP-H or PE-100 with intumescent wrap “PYRO-SAFE® DG-CR BS” – Wrap width 100 mm					
Outside pipe-Ø ≤ 50,0 mm	Wall 2x, Floor 1x 1-layer	EI 120 U/U	1	EI 120 U/U	1
Outside pipe-Ø ≤ 80,0 mm	Wall 2x, Floor 1x 2-layer	EI 120 U/U	1	EI 120 U/U	1
Outside pipe-Ø ≤ 110,0 mm	Wall 2x, Floor 1x 3-layer	EI 120 U/U	1	EI 120 U/U	1
Outside pipe-Ø ≤ 135,0 mm	Wall 2x, Floor 1x 4-layer	EI 120 U/C	1	EI 120 U/C	1
Outside pipe-Ø ≤ 160,0 mm	Wall 2x, Floor 1x 5-layer	EI 120 U/C	1	EI 120 U/C	1
HVAC split line combinations** with fire protection wrap “PYRO-SAFE® DG-CR 1.5“ – Wrap width 125 mm					
Pipe 1/Pipe 2 outside-Ø 6 mm - 10 mm/ 10 mm - 18 mm + PE-100 outside-Ø ≤ 25 mm, t 1.9 - 3.5 mm	2x 2-layer	EI 120	1	EI 120	1
Double solar pipes „NanoSUN²“ with fire protection wrap „PYRO-SAFE® DG-CR 1.5“ – Wrap width 125 mm					
DN16 and DN 25	Wall 2x, Floor 1x 1-layer	EI 120 C/U	2	EI 120 C/U	3
Hydraulic hoses „HANSA FLEX“ (also with wire braid reinforcement) with fire protection wrap „PYRO-SAFE® DG-CR 1.5“ – Wrap width 125 mm					
up to Ø 55.9 mm (Hansa-Flex HD 200 (2SN)) (e.g. hydraulic hoses for elevators) with additional cables	2x 1-layer + lamella mat ≥ 250 mm x ≥ 20 mm	EI 120	2	EI 120	3

*Classification report No.: 1 → 1883.1/14/Z00NP, 2 → KB 3.2/11-104-1, 3 → KB 3.2/11-103-1, 4 → 01883.2/14/Z00NP, 5 → 02761.3/16/Z00NP

**combined lines for split HVAC-units with twin or single copper pipe and pipe insulation 9 mm thick, made from PE foam, in accordance with EN 14313; optionally with additional cable/pipe without spacing.



PYRO-SAFE® Novasit BM

Fire resistance classes

PYRO-SAFE® CT Cable Tube – Retrofitting possibilities in walls

Length CT [mm]		150	200	300
Services	Measures			
Cable up to Ø 21 mm	-	EI 90 / E 120	EI 120	EI 120
Cable > Ø 21 mm to Ø 50 mm	-	EI 45 / E 90	EI 45 / E 90	EI 90 / E 120
Cable > Ø 50 mm to Ø 80 mm	-	-	-	EI 90 / E 120
Cable bundles up to Ø 107 mm with cable up to Ø 21 mm	-	EI 90 / E 120	EI 120	EI 120
Conduits up to 3 pcs. made of plastic, flexible Ø 32 mm with or w/o cable up to Ø 14 mm	-	EI 90 / E 90	EI 120	EI 120
Conduits made of plastic, flexible Ø 16 mm - 32 mm single or bundled up to Ø 107 mm, with w/o cable up to Ø ≤ 21 mm	-	-	EI 120	EI 120
max. 2 plastic pipes, outside pipe-Ø 20 mm x s 1.5 mm to Ø 32 mm x s 2.4 mm and max. 2 plastic pipes with outside pipe-Ø 20 mm x s 1.5 mm and up to 3 additional cable up to Ø ≤ 14 mm (sheathed cable with max. 5 wires ≤ 1.5 mm²)	-	-	-	EI 120
Combined lines for split HVAC-units Pipe 1/pipe 2 outside-Ø 6 mm - 10 mm/ 10 mm - 18 mm + 9 mm insulation made of PE-foam; Plastic pipe PVC-U, outside-Ø up to 25 mm, s 1.5 mm + max. 3 additional cable up to Ø 14 mm without spacing	-	EI 90 / E 90	EI 90 / E 90	EI 90 / E 90

Fire resistance classes


PYRO-SAFE® CT Cable Tube – Retrofitting possibilities in walls

Length CT [mm]		150	200	300
Services	Measures			
Cable up to Ø 21 mm	-	EI 90 / E 120	EI 120	EI 120
Cable > Ø 21 mm to Ø 50 mm	-	EI 45 / E 90	EI 45 / E 90	EI 90 / E 120
Cable > Ø 50 mm to Ø 80 mm	-	-	-	EI 90 / E 120
Cable bundles up to Ø 107 mm with cable up to Ø 21 mm	-	EI 90 / E 120	EI 120	EI 120
Conduits up to 3 pcs. made of plastic, flexible Ø 32 mm with or w/o cable up to Ø 14 mm	-	EI 90 / E 90	EI 120	EI 120
Conduits made of plastic, flexible Ø 16 mm - 32 mm single or bundled up to Ø 107 mm, with w/o cable up to Ø ≤ 21 mm	-	-	EI 120	EI 120
max. 2 plastic pipes, outside pipe-Ø 20 mm x s 1.5 mm to Ø 32 mm x s 2.4 mm and max. 2 plastic pipes with outside pipe-Ø 20 mm x s 1.5 mm and up to 3 additional cable up to Ø ≤ 14 mm (sheathed cable with max. 5 wires ≤ 1.5 mm²)	-	-	-	EI 120
Combined lines for split HVAC-units Pipe 1/pipe 2 outside-Ø 6 mm - 10 mm/ 10 mm - 18 mm + 9 mm insulation made of PE-foam; Plastic pipe PVC-U, outside-Ø up to 25 mm, s 1.5 mm + max. 3 additional cable up to Ø 14 mm without spacing	-	EI 90 / E 90	EI 90 / E 90	EI 90 / E 90

PYRO-SAFE® Novasit BM

1.7 Field of application (Dimensions)



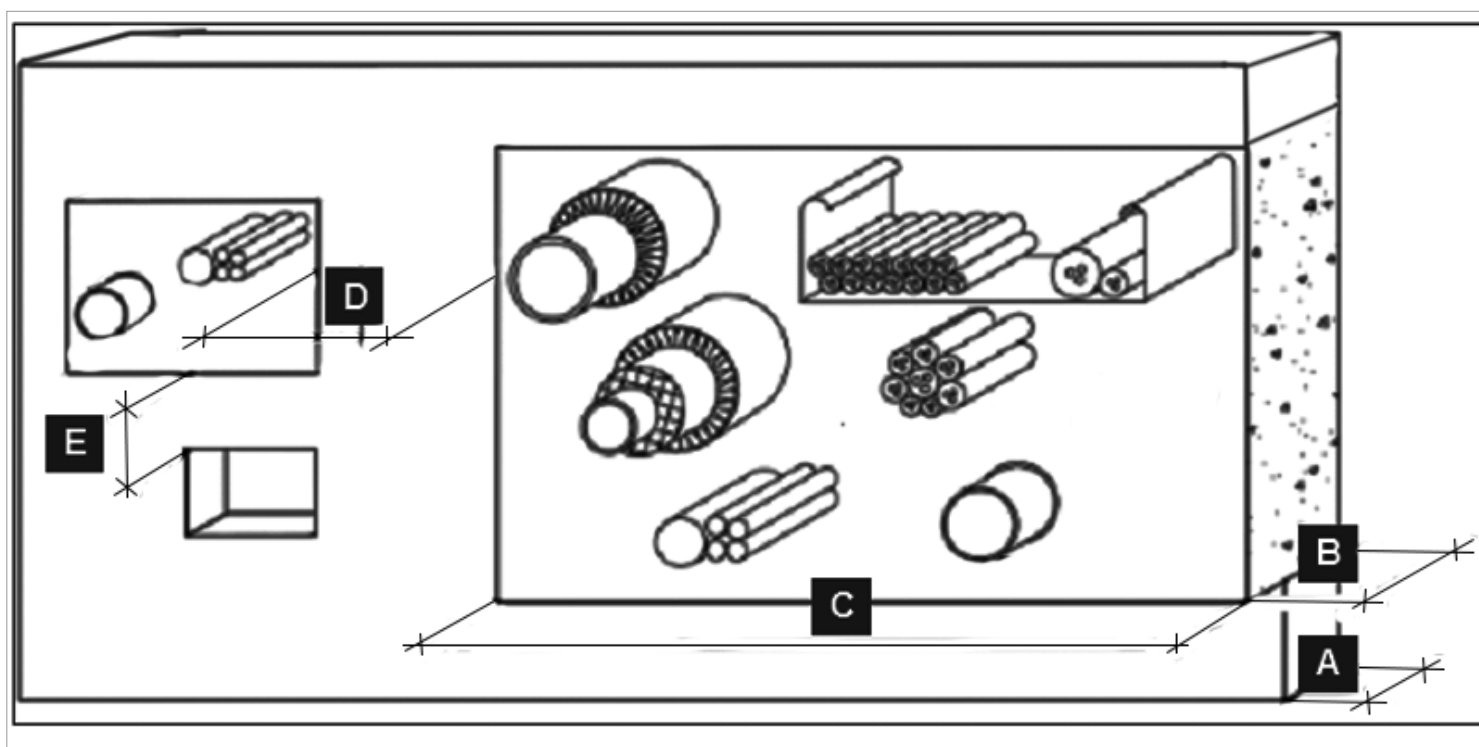



Dimensions			
Pos.	Legend	Wall [mm]	Floor [mm]
A	Thickness of structural element	≥ 150	≥ 150
B	Thickness of penetration seal	≥ 150	≥ 150
C	Maximum dimensions of the opening (width x height)	1200 x 2000	1200 x 2000
D	Distance to other cable- or pipe penetration seals one or both openings $> 400 \text{ mm} \times 400 \text{ mm}$	≥ 200	≥ 200
	Both openings $\leq 400 \text{ mm} \times 400 \text{ mm}$	≥ 100	≥ 100
E	Distance to other openings or installations one or both openings $> 200 \text{ mm} \times 200 \text{ mm}$	≥ 200	≥ 200
	Both openings $\leq 200 \text{ mm} \times 200 \text{ mm}$	≥ 100	≥ 100




PYRO-SAFE® Novasit BM

2. Allowed services

2.1 Cables / cable bundles / cable supports / Electrical installation conduits / PE lines

	<p>Electrical cables and lines of all types (including optical fibre cables)</p> <p>Overall cross-section of individual cable up to $\varnothing \leq 80$ mm</p>												
	<p>Cable bundles</p> <p>Up to $\varnothing \leq 100$ mm with cables up to $\varnothing \leq 21$ mm. No filling needed for tightly compressed and tied bundles.</p>												
	<p>Cable support constructions</p> <p>Cable ducts and trays made of steel, with organic coating if applicable, as long as the fire reaction class complies at least with class A2 according to EN 13501-1.</p>												
	<p>Electrical installation conduits, single made of plastic.</p> <p>Outer $\varnothing \leq 100$ mm, with/without cable assignment $\varnothing \leq 50$ mm.</p>												
	<p>Bundled electrical installation conduits made of plastic</p> <p>Outside-$\varnothing \leq 100$ mm, Single conduits outside-$\varnothing \leq 32$ mm, with or w/o cables ($\varnothing \leq 21$ mm)</p>												
	<p>PE lines“speed pipes” (for glass fibre cables and micro-cables)</p> <p>Single cables or bundles with or w/o glass fibre cable by Gabocom Systemtechnik GmbH.</p> <table><tr><th>Outside pipe-\varnothing [mm]</th><th>Max. qty. [pcs]</th><th>Pipe wall thickness [mm]</th></tr><tr><td>≤ 7</td><td>24</td><td>$\leq 1,5$</td></tr><tr><td>≤ 10</td><td>7</td><td>$\leq 2,0$</td></tr><tr><td>≤ 12</td><td>5</td><td>$\leq 2,0$</td></tr></table>	Outside pipe- \varnothing [mm]	Max. qty. [pcs]	Pipe wall thickness [mm]	≤ 7	24	$\leq 1,5$	≤ 10	7	$\leq 2,0$	≤ 12	5	$\leq 2,0$
Outside pipe- \varnothing [mm]	Max. qty. [pcs]	Pipe wall thickness [mm]											
≤ 7	24	$\leq 1,5$											
≤ 10	7	$\leq 2,0$											
≤ 12	5	$\leq 2,0$											

2.2 Combustible pipes



Combustible pipes

with fire protection wrap PYRO-SAFE® DG-CR BS up to an outside-Ø ≤ 160 mm; optionally with w/o acoustic insulation tube made of 5 mm PE-foam.

Ventilated sewer pipes and closed piping systems. Circulation of non-combustible liquids and gases allowed (except ventilation lines).

PVC-U, PVC-C		PP-H		PE 100	
Norms: EN 1329-1, EN 1453-1, EN 1542-1, EN 15493, DIN 8061/8062, EN 1566-1		Norms: EN 1555-2, EN 12201-2+A1, DIN 8074/8075, EN 15874, DIN 8077/8078		Norms: EN 1555-2, EN 12201-2+A1, DIN 8074/8075	
Outside pipe-Ø [mm]	Pipe wall thickness [mm]	Outside pipe-Ø [mm]	Pipe wall thickness [mm]	Outside pipe-Ø [mm]	Pipe wall thickness [mm]
≤ 50	1,8 - 3,7	≤ 50	1,8 - 4,6	≤ 50	1,8 - 4,8
≤ 110	2,2 - 8,2	≤ 110	2,7 - 10,0	≤ 110	2,7 - 10,0
≤ 160	3,2 - 11,9	≤ 160	3,9 - 9,1	≤ 160	3,9 - 9,1

PYRO-SAFE® Novasit BM

2.3 Multilayer pipes „HENCO pipes“



Multilayer pipes „HENCO Pipes“

Pipes in a multi-layered network and cross-linked PE (PE-Xc/Al/PE-Xc) by HENCO with an outside-Ø ≤ 63,0 mm

2.4 Non-combustible pipes



Non-combustible pipes

Pipes made of steel, stainless steel, cast iron or copper

Pipe materials / insulation	Outside-Ø [mm]
Copper with non-combustible pipe insulation made of mineral-fibre, e.g. "Klimarock" or "Conlit U"	≤ 108,0
Steel, stainless steel, cast iron with non-combustible insulation made of mineral-fibre, e.g. "Klimarock" or "Conlit U"	≤ 323,9*
Copper with combustible insulation made of FEF „Armaflex Protect“	≤ 108,0
Steel, stainless steel, cast iron with combustible insulation made of FEF „Armaflex Protect“	≤ 170,0
Copper with combustible insulation made of FEF „NH/Armaflex“	≤ 108,0
Steel, stainless steel, cast iron with combustible insulation made of FEF „NH/Armaflex“	≤ 168,3

The penetration seal may also be used for pipes made from other metals, whose heat transfer rate is lower than that of steel or copper, with a melting point ≥ 1049°C.

Non-combustible pipes		Pipe wall thickness [mm]
Material	Outside-Ø [mm]	min. / max.
Copper, steel, stainless steel, cast iron	Ø ≤ 15,0	≥ 0,8
	Ø > 15,0 - ≤ 108,0	≥ 1,0 - ≥ 2,5 / ≤ 14,2
Steel, stainless steel, cast iron	Ø > 108,0 - ≤ 323,9	≥ 2,6 - ≥ 7,5 / ≤ 14,2

PYRO-SAFE® Novasit BM

2.5 Further allowed services



HVAC split line combinations

E.g. "Tubolit DuoSplit" or "Tubolit Split" by Armacell or any other manufacturer with same characteristics. Double or single copper pipe and 9 mm thick insulation made of PE foam according to EN 14313 with an accessory line (1.5 mm thick plastic pipe (U/U) made of PVC-U, outside Ø 25 mm, according to EN 1453-1 or EN 1452-1 and to DIN 8061/DIN 8062 and up to 2 sheath cables with max. 5 wires with a surface $\leq 1.5 \text{ mm}^2$, $\varnothing \leq 14 \text{ mm}$) without spacing.



Double solar pipes „NanoSUN²“

Pipes for solar thermal applications made of corrugated stainless steel with insulation, an accessory line integrated in the insulation and a PVC sheath by Aktarus Group Srl. $\varnothing \leq \text{DN } 25$.




Hydraulic hoses „HANSA FLEX“ with wire braid reinforcement

of the type "HD 200 (2SN)" according to DIN EN 853 for mineral oils, $\varnothing \leq 55.9 \text{ mm}$.


PYRO-SAFE® Novasit BM

2.6 PYRO-SAFE® CT Cable Tube (for retrofitting)




“PYRO-SAFE® CT” cable tube with intumescent inlining in accordance with ETA-13/0821 and ETA-16/0016

“PYRO-SAFE® CT” cable tube with intumescent inlining in accordance with ETA-13/0821 and ETA-16/0016




Electrical cables and lines of all types (including optical fibre cables) with „PYRO-SAFE® CT“

Overall cross-section of individual cable up to $\varnothing \leq 80$ mm if the „PYRO-SAFE® CT“ cable tube is used




Cable bundles with „PYRO-SAFE® CT“

Cable bundles up to $\varnothing \leq 107$ mm with cables $\varnothing \leq 21$ mm if the „PYRO-SAFE® CT“ cable tube is used.




Electrical installation conduits with „PYRO-SAFE® CT“

Made of plastic (flexible) outside- \varnothing 16 mm to 32 mm single or bundled up to \varnothing 107, with w/o cables - $\varnothing \leq 21$ mm.
Single conduits - \varnothing 63 mm (floor only)




Combustible pipes with additional cables with „PYRO-SAFE® CT“

max. 4 PVC plastic pipes, 2 pipes with outside- \varnothing 20 mm to 32 mm and 2 pipes with outside- \varnothing up to 20 mm as well as max. 3 additional cable up to \varnothing 14 mm are allowed.



HVAC split line combinations with „PYRO-SAFE® CT“

Double or single copper pipe (Pipe 1/pipe 2 outside- \varnothing 6 mm - 10 mm/ 10 mm - 18 mm) and 9 mm thick insulation made of PE foam according to EN 14313 with an accessory line (1.5 mm thick plastic pipe (U/U) made of PVC-U, outside \varnothing 25 mm, according to EN 1453-1 or EN 1452-1 and to DIN 8061/DIN 8062 and up to 3 sheath cables with max. 5 wires with a surface ≤ 1.5 mm², $\varnothing \leq 14$ mm) without spacing.



PE lines “speed pipes” (for glass fibre cables and micro-cables) with „PYRO-SAFE® CT“


Single cables or bundles with or w/o glass fibre cable by Gabocom Systemtechnik GmbH.

Outside pipe- \varnothing [mm]	Max. qty. [Stk.]	Pipe wall thickness [mm]
≤ 7	24	$\leq 1,5$
≤ 10	7	$\leq 2,0$
≤ 12	5	$\leq 2,0$


























The entire permitted cross-section of the installations (outside dimensions) is ≤ 60 % of the bare masonry opening!

3. Spacing requirements

Spacing requirements – walls


															Seal edge		
		Cables	Cable bundles	Cable trays	Electrical installation conduits single or bundled	Combustible pipes	Multilayer pipes	Non-combustible pipes: Insulation made of mineral-fibre mats	Non-combustible pipes: Insulation made of FEF	HVAC split line combinations	Double solar pipes „NanoSUN2“	PE lines „speed pipes“	Hydraulic hoses „HANSA FLEX“	PYRO-SAFE® CT Cable Tube	Upper	Under	Side
	Cables	≥ 10 (≥ 50 one above the other)			Cable ≤ 21 : ≥ 0 Cable > 21 : ≥ 100	≥ 50	Cable ≤ 21 : ≥ 0 Cable > 21 : ≥ 100	≥ 35	≥ 35	≥ 40	≥ 100	≥ 25	≥ 45	≥ 65	≥ 30	≥ 0	≥ 0
	Cable bundles	≥ 10 (≥ 50 one above the other)			≥ 100	≥ 50	≥ 100	≥ 35	≥ 35	≥ 40	≥ 100	≥ 25	≥ 45	≥ 65	≥ 30	≥ 0	≥ 0
	Cable trays	≥ 10 (≥ 50 one above the other)			≥ 100	≥ 50	≥ 100	≥ 35	≥ 35	≥ 40	≥ 100	≥ 25	≥ 45	≥ 65	≥ 30	≥ 0	≥ 0
	Electrical installation conduits single or bundled	Cable ≤ 21 : ≥ 0 Cable > 21 : ≥ 100	≥ 100			≥ 0	≥ 100	≥ 100	≥ 80	≥ 80	≥ 100	≥ 100	≥ 100	≥ 100	≥ 0		
	Combustible pipes	≥ 50			≥ 100	≥ 0	≥ 100	≥ 0	≥ 0	≥ 50	≥ 100	≥ 100	≥ 100	≥ 100	≥ 0		
	Multilayer pipes	Cable ≤ 21 : ≥ 0 Cable > 21 : ≥ 100	≥ 100			≥ 100	≥ 100	≥ 0	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 0		
	Non-combustible pipes; Insulation made of mineral-fibre mats	≥ 50			≥ 80	≥ 0	≥ 100	≥ 0	≥ 0	≥ 50	≥ 100	≥ 20	≥ 100	≥ 100	≥ 0		
	Non-combustible pipes; Insulation made of FEF	≥ 50			≥ 80	≥ 0	≥ 100	≥ 0	≥ 0	≥ 50	≥ 100	≥ 20	≥ 100	≥ 100	≥ 0		
	HVAC split line combinations	≥ 40			≥ 100	≥ 50	≥ 100	≥ 50	≥ 50	≥ 25	≥ 85	≥ 100	≥ 100	≥ 100	≥ 0		
	Double solar pipes „NanoSUN2“	≥ 100			≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 85	≥ 100	≥ 100	≥ 85	≥ 100	≥ 0		
	PE lines „speed pipes“	≥ 25			≥ 100	≥ 100	≥ 100	≥ 20	≥ 20	≥ 100	≥ 100	≥ 25	≥ 100	≥ 100	≥ 0		
	Hydraulic hoses „HANSA FLEX“	≥ 45			≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 85	≥ 100	≥ 100	≥ 100	≥ 80		
	PYRO-SAFE® CT Cable Tube	≥ 65			≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 3	≥ 15		


Spacing requirements – floors


															Seal edge		
		Cables	Cable bundles	Cable trays	Electrical installation conduits single or bundled	Combustible pipes	Multilayer pipes	Non-combustible pipes; Insulation made of mineral-fibre mats	Non-combustible pipes; Insulation made of FEF	HVAC split line combinations	Double solar pipes „NanoSUN“	PE lines „speed pipes“	Hydraulic hoses „HANSA FLEX“	PYRO-SAFE® CT Cable Tube	Front	Back	Side
	Cables	Seal thickness ≥ 150 : ≥ 10 , (≥ 50 one above the other) Seal thickness ≥ 240 : ≥ 0 , (≥ 45 one above the other)			Cable ≤ 21 : ≥ 0 Cable > 21 : ≥ 100	≥ 50	Cable ≤ 21 : ≥ 0 Cable > 21 : ≥ 100	≥ 25	≥ 25	≥ 100	≥ 100	≥ 40	≥ 85	≥ 65	≥ 30	≥ 0	Seal thickness ≥ 150 : ≥ 10 Seal thickness ≥ 240 : ≥ 25
	Cable bundles	Seal thickness ≥ 150 : ≥ 10 , (≥ 50 one above the other) Seal thickness ≥ 240 : ≥ 0 , (≥ 45 one above the other)			≥ 100	≥ 50	≥ 100	≥ 25	≥ 25	≥ 100	≥ 100	≥ 40	≥ 85	≥ 65	≥ 30	≥ 0	Seal thickness ≥ 150 : ≥ 10 Seal thickness ≥ 240 : ≥ 25
	Cable trays	Seal thickness ≥ 150 : ≥ 10 , (≥ 50 one above the other) Seal thickness ≥ 240 : ≥ 0 , (≥ 45 one above the other)			≥ 100	≥ 50	≥ 100	≥ 25	≥ 25	≥ 100	≥ 100	≥ 40	≥ 85	≥ 65	≥ 30	≥ 0	Seal thickness ≥ 150 : ≥ 10 Seal thickness ≥ 240 : ≥ 25
	Electrical installation conduits single or bundled	Cable ≤ 21 : ≥ 0 Cable > 21 : ≥ 100	≥ 100		≥ 0	≥ 100	≥ 100	≥ 60	≥ 60	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 0		
	Combustible pipes	≥ 50			≥ 100	≥ 25	≥ 100	≥ 0	≥ 0	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 0		
	Multilayer pipes	Cable ≤ 21 : ≥ 0 Cable > 21 : ≥ 100	≥ 100		≥ 100	≥ 100	≥ 0	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 0		
	Non-combustible pipes; Insulation made of mineral-fibre mats	≥ 25			≥ 100	≥ 0	≥ 100	≥ 0	≥ 0	≥ 60	≥ 100	≥ 100	≥ 100	≥ 100	≥ 0		
	Non-combustible pipes; Insulation made of FEF	≥ 25			≥ 100	≥ 0	≥ 100	≥ 0	≥ 0	≥ 60	≥ 100	≥ 100	≥ 100	≥ 100	≥ 0		
	HVAC split line combinations	≥ 100			≥ 100	≥ 100	≥ 100	≥ 60	≥ 60	≥ 50	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100		
	Double solar pipes „NanoSUN“	≥ 100			≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 80	≥ 100	≥ 30		
	PE lines „speed pipes“	≥ 40			≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 25	≥ 100	≥ 100	≥ 30		
	Hydraulic hoses „HANSA FLEX“	≥ 85			≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 80	≥ 100	≥ 100	≥ 100	≥ 35		
	PYRO-SAFE® CT Cable Tube	≥ 65			≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 100	≥ 10	≥ 15		


PYRO-SAFE® Novasit BM


4. Used products


	<p>PYRO-SAFE® NOVASIT BM Fire protection mortar</p> <p>In accordance with ETA-16/0132</p> <p>20 kg Bag – Product No. 01161000 10 kg Pail – Product No. 01161010</p>
---	---


	<p>PYRO-SAFE® FLAMMOTECT-A Filler</p> <p>In accordance with ETA-14/0418</p> <p>12,5 kg Pail – Product No. 01155104 15,0 kg Pail – Product No. 01155109 310 ml cartridge – Product No. 01155115</p>
--	--


	<p>PYRO-SAFE® DG-CR 1.5 Fire protection wrap</p> <p>In accordance with ETA-16/0268</p> <p>Roll à 10 m x 125 mm – Product No. 01261125</p>
--	---

	<p>PYRO-SAFE® DG-CR BS Fire protection wrap</p> <p>In accordance with ETA-16/0268</p> <p>Roll à 10 m x 100 mm – Product No. 01264100</p>
--	--

	<p>PYRO-SAFE® CT Cable Tube</p> <p>In accordance with ETA-13/0821 and ETA-16/0016</p> <p>Lengths 150 mm, 200 mm, 300 mm Outside-Ø 116,4 mm Inside-Ø 107 mm</p> <p>CT 150 – Product No. 01281150 CT 200 – Product No. 01281200 CT 300 – Product No. 01281300</p>
--	--

	<p>Lamella mat „KLIMAROCK“</p> <p>In accordance with DIN EN 14303 and DoP DE0628011501 dated 06.08.2015</p> <p>Reaction to fire class according to EN 13501-1: Class A2-s1 d0</p> <p>Dimensions ≥ 610 x 50 cm Thickness 30 mm Roll à 3,05 m² – product No. 01187100</p> <p>It is allowed to apply any lamella mats/ mineral fibre mats/ mineral fibre pipe shells if they match the following requirements: EN 14303 density ≥ 40 kg/g³ Reaction to fire class according to EN 13501-1: Class A2-s1 d0 or better A1 in accordance with EN 13501-1 Thickness = minimum 30 mm</p>									
	<table> <tr> <th>Name</th><th>Nominal density kg/m³</th><th>In accordance with abZ/abP/Declaration of performance</th></tr> <tr> <td>Rockwool lamella mat „KLIMAROCK“ Product No. 01187100</td><td>40-50</td><td>DE0628011501 of 06.08.2015</td></tr> <tr> <td>Rockwool Conlit U</td><td>150</td><td>P-NDS04-417</td></tr> </table>	Name	Nominal density kg/m ³	In accordance with abZ/abP/Declaration of performance	Rockwool lamella mat „KLIMAROCK“ Product No. 01187100	40-50	DE0628011501 of 06.08.2015	Rockwool Conlit U	150	P-NDS04-417
Name	Nominal density kg/m ³	In accordance with abZ/abP/Declaration of performance								
Rockwool lamella mat „KLIMAROCK“ Product No. 01187100	40-50	DE0628011501 of 06.08.2015								
Rockwool Conlit U	150	P-NDS04-417								

	<p>Label</p> <p>1 piece – Product No. 01229000</p>
---	---


	<p>Recommended tools</p> <p>Mixing container – mortar cask Mixing paddle Cover sheeting Masonry tools (round dippers) Wire binding pliers, size 10 key or ratchet steel wire</p>
--	---

PYRO-SAFE® Novasit BM

5. Regulations and variants

- The combination penetration seal may be used for closing openings without installations (so-called reserve penetration seal).
- Penetration seal in floors shall be protected on site by client with suitable barriers or covered with grating, in order to prevent them from being load or walked on.
- During installation in walls, one side can be boxed in if necessary and, for floor penetration seals, the underside can be boxed in.
- For installation in floors, sealing surfaces larger than 500 mm x 500 mm without penetration of cables and cable trays must be carried out with a professional friction-locked steel reinforcement.


Variants in solid walls

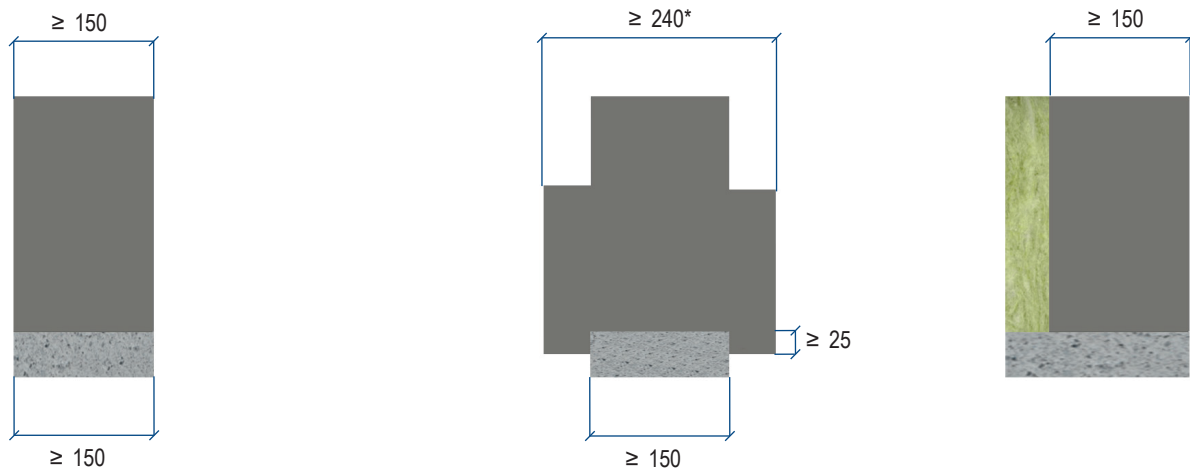

PYRO-SAFE® NOVASIT BM fire protection mortar
Lost formwork e.g. made of mineral fibre mat (non-flammable, melting point > 1000 °C)

Dimension in mm

Variants in floors

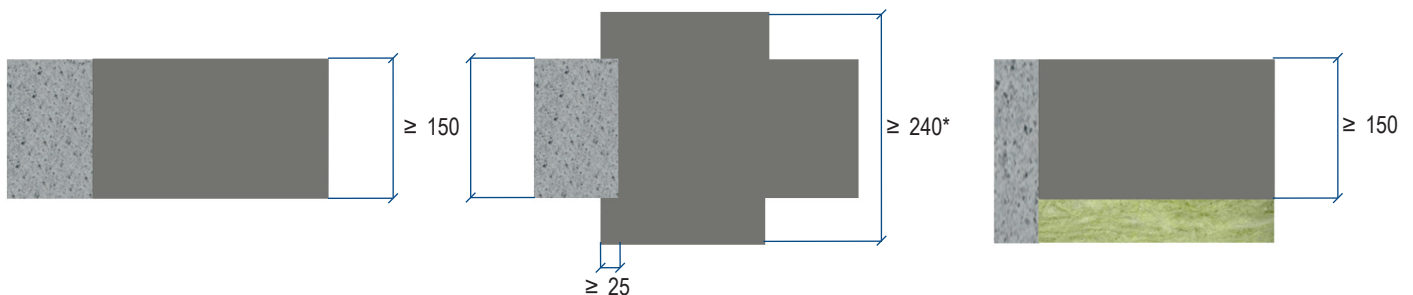

PYRO-SAFE® NOVASIT BM fire protection mortar
Lost formwork e.g. made of mineral fibre mat (non-flammable, melting point > 1000 °C)


Dimension in mm

* Bulkhead thickness 240 mm see page 19.

PYRO-SAFE® Novasit BM

5.1 Rules over the first cable/pipe support

- The core of the first supports before the installation shall be made of non-combustible material (fire resistance class A1 or A2 according to EN 13501-1) and the supports shall be placed at a distance according to the table below.

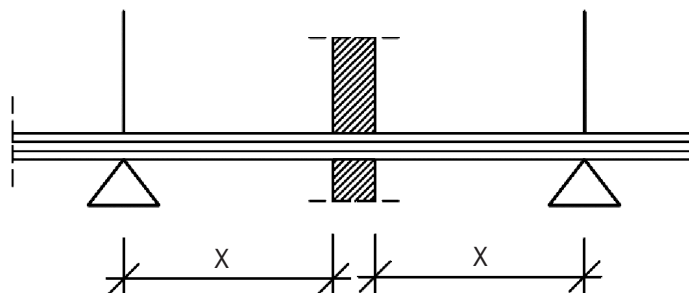

First holder (support) of the installations in front of the wall partition made of steel or equivalent.

First cable/pipe support

Cables, cable bundles, cable trays	Wall	≤ 500 mm
	Floor	≤ 400 mm
Electrical installation conduits		≤ 500 mm
Combustible pipes		≤ 500 mm
Multilayer pipes „HENCO pipes“		≤ 400 mm
Non-combustible pipes - section insulation made of mineral fibre mats or shells		L* + 50 mm
Non-combustible pipes - section insulation made of FEF		
Double solar pipes „NanoSUN2“		≤ 500 mm
PE lines „speed pipes“ for glass fibre cables and micro-cables		**
HVAC split line combinations		≤ 500 mm
Hydraulic hoses „HANSA-FLEX“ with wire braid reinforcement		≤ 500 mm
PYRO-SAFE® CT installations in the cable tube		≤ 300 mm

* L = Length of the protective insulation

** The manufacturer's installation instructions are applied.



PYRO-SAFE® Novasit BM

6. Fire protection measures

6.1 Cables / cable bundles / cable trays

- The feed-through of cables or cable bundles is permitted without and with cable trays.
- Cable bundles can be installed unopened through the penetration sealing. If they consist of parallel-running cables that are densely packed and permanently bound, stitched or welded together they don't have to be filled inside with filler material.
- The support structures of the cable trays shall be formed so that, in case of fire, no additional mechanical loading of the penetration sealing can occur.
- For cable support structures made of sheet steel, the spars must be drilled and filled with the ablative coating PYRO-SAFE® FLAMMOTECT-A in the penetration area (on-site agreement of the measures required).

Measures for sealing in walls and floors without further measures

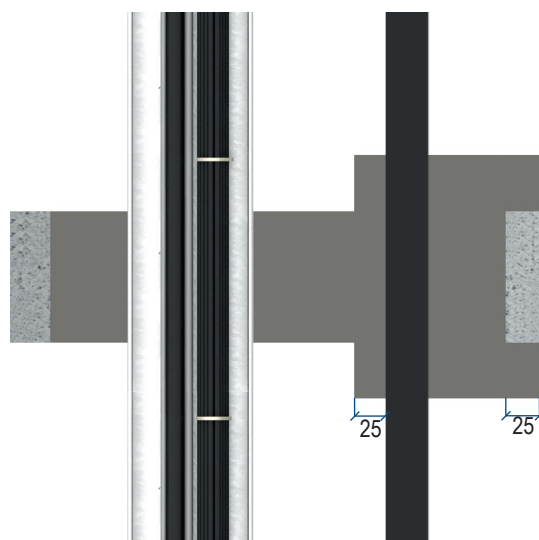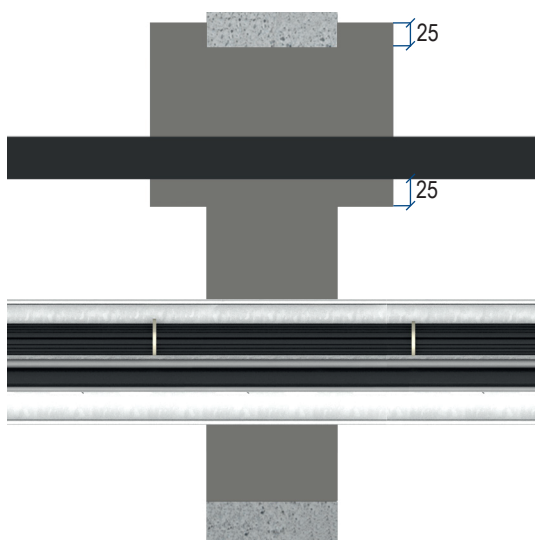

PYRO-SAFE® NOVASIT BM fire protection mortar

Wall/Floor-, seal thickness and implementation variants see page 17


Dimension in mm

	Dimensions [mm]	Seal thickness [mm]	Fire resistance class	
			Wall	Floor
Cables	$\varnothing \leq 32$	150	EI 120	EI 120
	$\varnothing \leq 50$	240	EI 120	EI 90 / E 120
	$\varnothing \leq 80$		EI 90 / E 120	EI 90
Single-core-non-sheathed cables	\varnothing wires ≤ 24	150	EI 120	EI 120
Cable bundles	$\varnothing \leq 60$		EI 120	EI 120
	$\varnothing \leq 100$		EI 90 / E 120	EI 60 / E 120
		240	EI 120	EI 120

PYRO-SAFE® Novasit BM

- The PYRO-SAFE® DG-CR 1.5 fire protection wrap is coated and covered with a protective film on one side. Before installation the protective film shall be removed, the coated side have to be inside. Fixation of the wrap with steel wires.

Measures for sealing in walls and floors fire protection wrap „PYRO-SAFE® DG-CR 1.5“

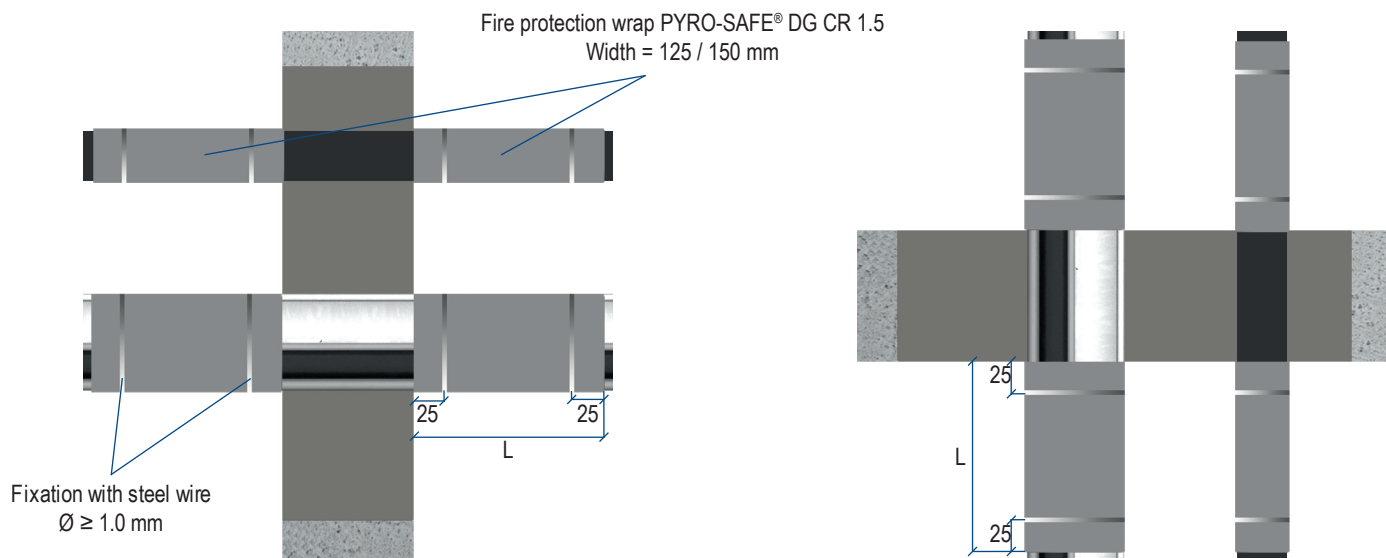

PYRO-SAFE® NOVASIT BM fire protection mortar

Wall/Floor-, seal thickness and implementation variants see page 17

Dimension in mm


	Dimensions [mm]	Fire protection wrap PYRO-SAFE® DG-CR 1.5						Fire resistance class	
		Wrap width L [mm]	Qty. wraps [n]	Qty. layers [n]	Overlapping [mm]	Inside seal [mm]	Outside seal [mm]	Wall	Floor
Cable	Ø ≤ 32	-	-	-	-	-	-	EI 120	EI 120
	Ø ≤ 50	125	2	2	45 - 60	0	125	EI 120	EI 120
	Ø ≤ 80							EI 90 / E 120	EI 120
		150					150	EI 120	EI 120
Cable bundles	Ø ≤ 100	125		1			125	EI 120	EI 120

PYRO-SAFE® Novasit BM

6.2 Electrical installation conduits (EIC) single or bundled

- The PYRO-SAFE® DG-CR 1.5 fire protection wrap is coated and covered with a protective film on one side. Before installation the protective film shall be removed, the coated side have to be inside. Fixation of the wrap with steel wires.

Measures for sealing in walls and floors with fire protection wrap „PYRO-SAFE® DG-CR 1.5“

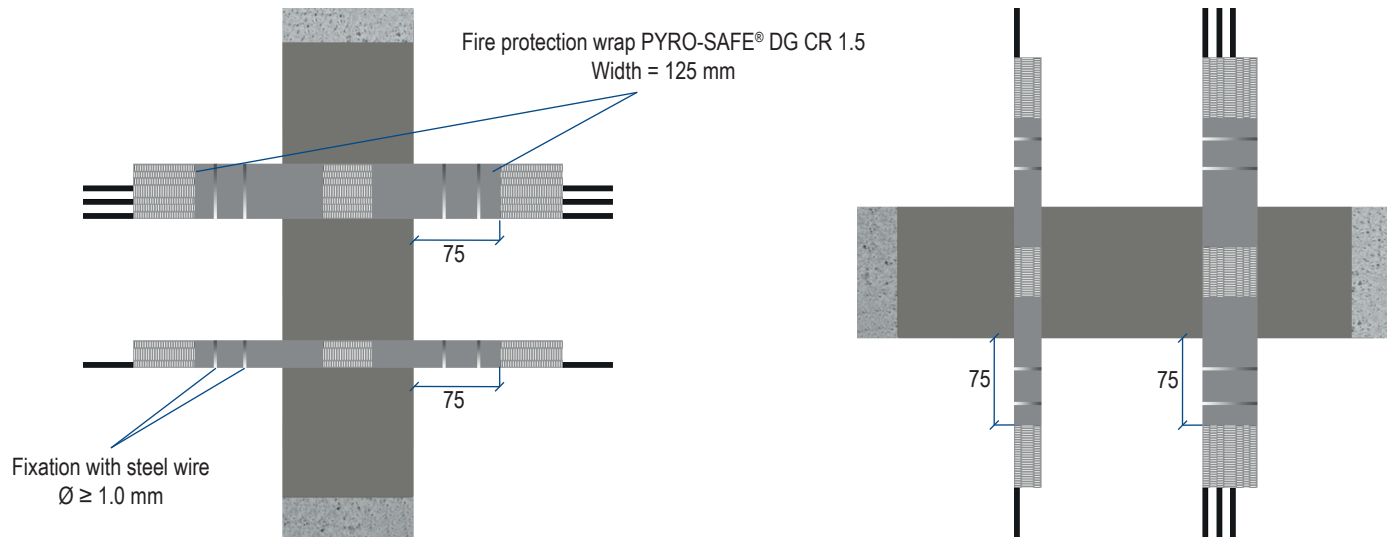

PYRO-SAFE® NOVASIT BM fire protection mortar

Wall-/Floor-, seal thickness and implementation variants see page 17

Dimension in mm

	Dimensions [mm]	Fire protection wrap PYRO-SAFE® DG-CR 1.5						Fire resistance class	
		Wrap width [mm]	Qty. wraps [n]	Qty. layers [n]	Overlapping [mm]	Inside seal [mm]	Outside seal [mm]	Wall	Floor
EIC made of plastic, single	EIC- $\varnothing \leq 32$ cable- $\varnothing \leq 21$			1				EI 120 U/U	EI 120 U/U
	EIC- $\varnothing \leq 63$ cable- $\varnothing \leq 21$			2				EI 120 U/U	
EIC made of plastic, single*	EIC- $\varnothing \leq 100$ cable- $\varnothing \leq 50$	125	2	3	0	50	75	-	
EIC made of plastic, bundled	bundle- $\varnothing \leq 100$ EIC- $\varnothing \leq 32$ cable- $\varnothing \leq 21$			2				EI 120 U/U	

* With additional protective insulation made of mineral-fibre mats ($L1 \geq 500 \text{ mm} \times D1 \geq 30 \text{ mm}$)



PYRO-SAFE® Novasit BM

6.3 Electrical installation conduits (EIC) single - application with mineral-fibre mats

- Electrical installation conduits (EIC) with or w/o cables (cable- $\varnothing \leq 22,0$ mm) can be installed.
- A section insulation made of mineral-fibre mats or -shells is necessary. The section insulation shall be fixed with steel wires.

Measures for sealing in walls and floors

Close on both sides with mineral-fibre wool
(+ sealing if cables are installed)

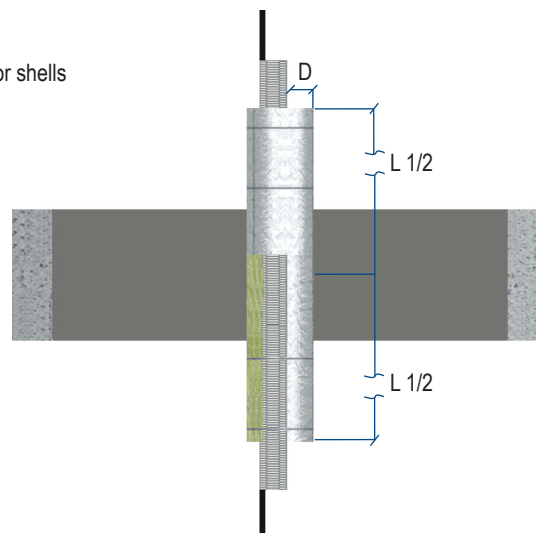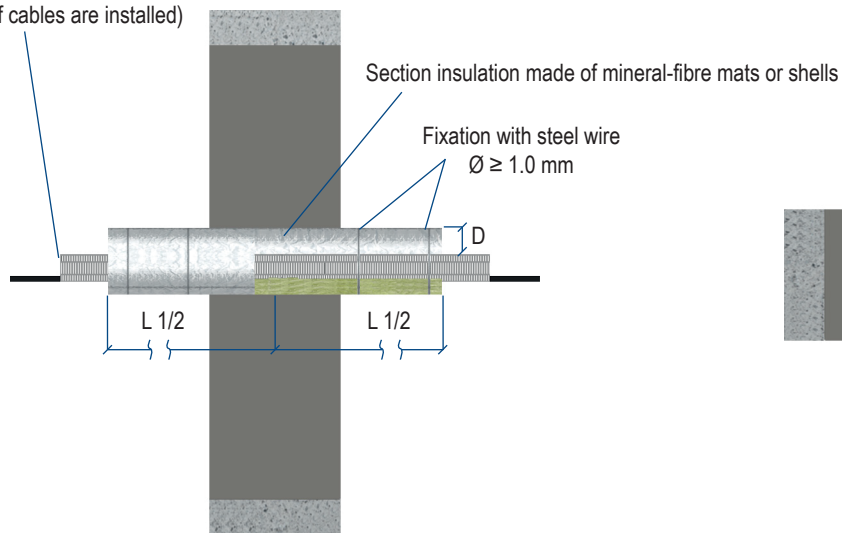

PYRO-SAFE® NOVASIT BM fire protection mortar

Wall-/Floor-, seal thickness and implementation variants see page 17

Dimension in mm


EIC-material	EIC outside- \varnothing [mm]	Section insulation		Fire resistance class	
		Thickness [mm]	Length L 1/2 [mm]	Wall	Floor
PE-HD	≤ 63	≥ 30	≥ 500	EI 120 U/C	EI 120 U/C

PYRO-SAFE® Novasit BM

6.4 PE lines “speed pipes” (for glass fibre cables and micro cables)

- The “speed pipe” PE lines must be arranged vertical to the component’s surface. Pipe end configuration (U/U).
- The “speed pipe” PE lines must be wrapped on both sides with the PYRO-SAFE® DG-CR 1.5 fire protection wrap (width 125 mm).
- The PYRO-SAFE® DG-CR 1.5 fire protection wrap is coated and covered with a protective film on one side. Before installation the protective film shall be removed, the coated side have to be inside. Fixation of the wrap with steel wires.
- The wrap must be arranged in such a way that it is 75 mm in the partition.

Measures for sealing in walls and floors

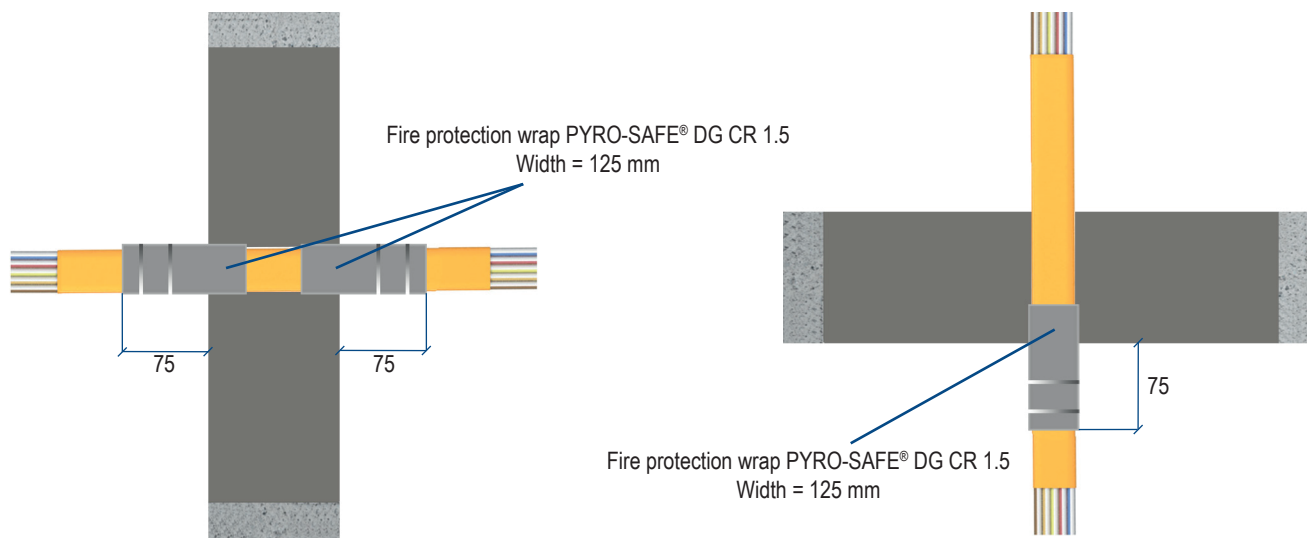

PYRO-SAFE® NOVASIT BM fire protection mortar
Wall/Floor-, seal thickness and implementation variants see page 17

Dimension in mm


Set-up Speed pipes	Wall thickness [mm]	Fire protection wrap PYRO-SAFE® DG-CR 1.5						Fire resistance class	
		Wrap width [mm]	Qty. wraps [n]	Qty. layers [n]	Overlapping [mm]	Inside seal [mm]	Outside seal [mm]	Wall	Floor
Ø 7,0 mm x 24 Pcs	≥ 1,5	125	2	1	0	50	75	EI 120 U/U	-
Ø 10,0 mm x 7 Pcs	≥ 2,0								
Ø 12,00 mm x 5 Pcs	≥ 2,0								
Ø 7,0 mm x 24 Pcs	≥ 1,5		1	2				-	EI 120 U/U
Ø 10,0 mm x 7 Pcs	≥ 2,0								
Ø 12,00 mm x 5 Pcs	≥ 2,0								

PYRO-SAFE® Novasit BM

6.5 Combustible pipes

- For wall sealing, install the fire protection wrap PYRO-SAFE® DG-CR BS (width = 100 mm) on both sides; for floor penetration sealing install only one PYRO-SAFE® DG-CR BS fire protection wrap (width = 100 mm) bottom of the floor.
- Pipes shall be installed vertical to the barrier's surface.
- The penetration sealing may be used on pneumatic conveyors, compressed air lines and so on if the pipeline system is switched off in the event of a fire.
- Optional with w/o an acoustic insulation made of 5 mm PE-foam.

Measures for sealing in walls and floors with fire protection wrap „PYRO-SAFE® DG-CR BS“

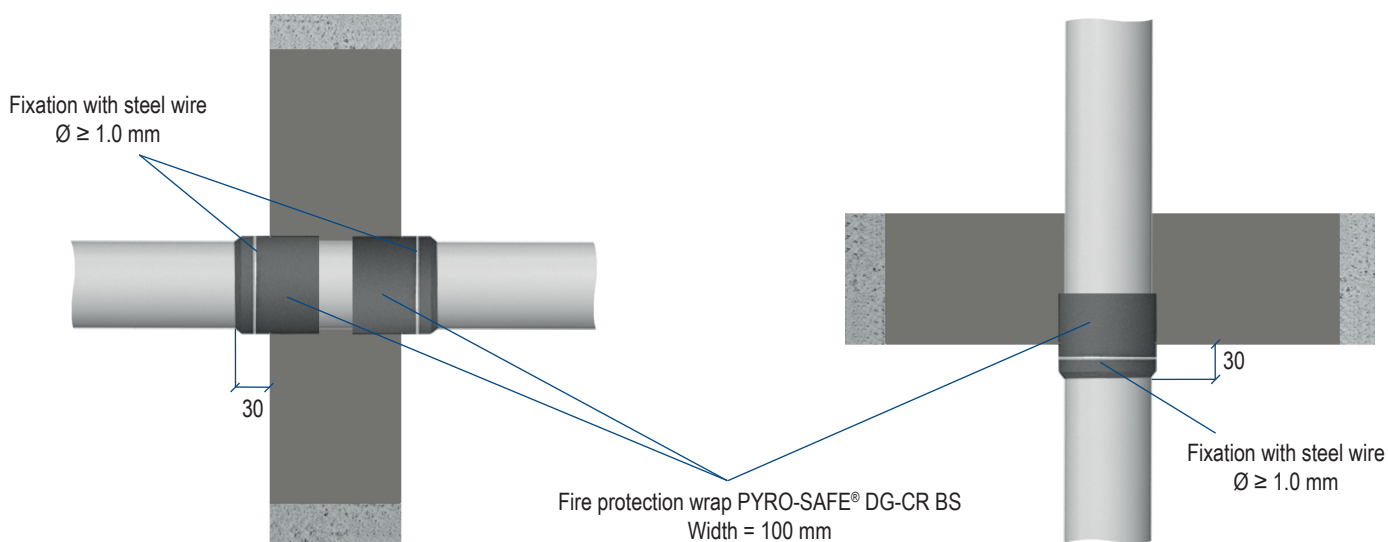

PYRO-SAFE® NOVASIT BM fire protection mortar

Wall/Floor-, seal thickness and implementation variants see page 17


Dimension in mm

Dimensions [mm]	Fire protection wrap PYRO-SAFE® DG-CR BS						Fire resistance class	
	Wrap width [mm]	Qty. wraps [n]	Qty. layers [n]	Overlapping [mm]	Inside seal [mm]	Outside seal [mm]	Wall	Floor
≤ Ø 50	100	2	1	0	70	30	EI 120 U/U	-
> Ø 50 - 80			2					
> Ø 80 - 110			3					
> Ø 110 - 135			4					
> Ø 135 - 160			5					
≤ Ø 50	100	1	1	0	70	30	-	EI 120 U/U
> Ø 50 - 80			2					
> Ø 80 - 110			3					
> Ø 110 - 135			4					
> Ø 135 - 160			5					

PYRO-SAFE® Novasit BM

6.6 Multilayer pipes „HENCO pipes“

Measures for sealing in walls and floors

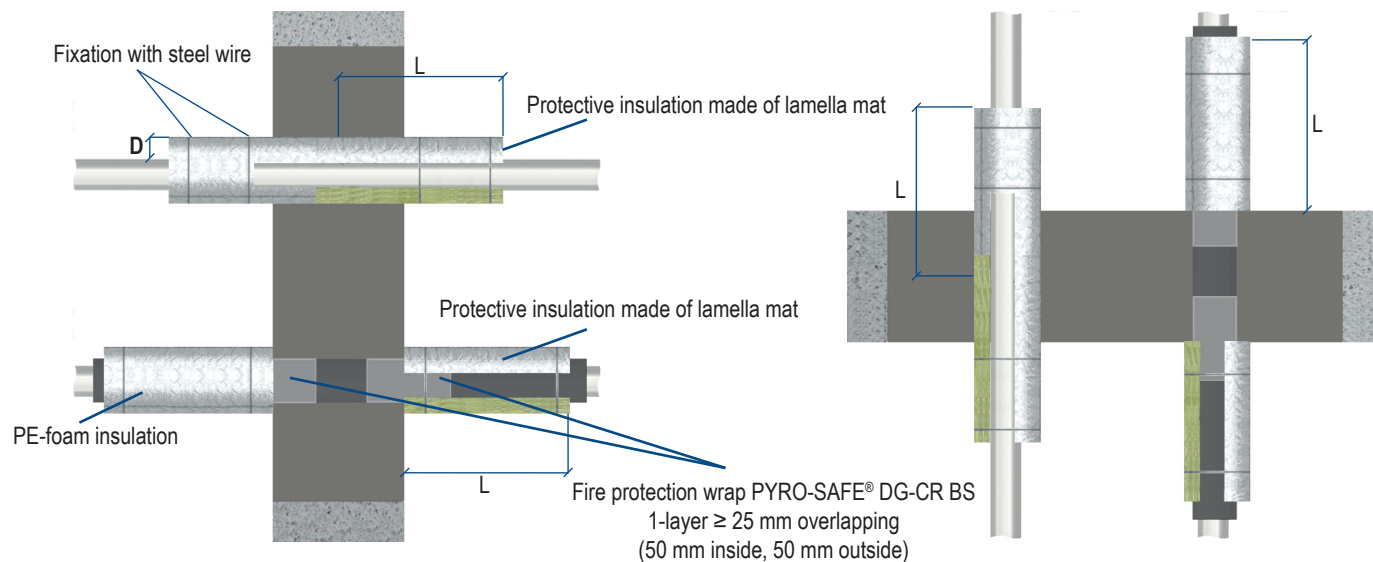

PYRO-SAFE® NOVASIT BM fire protection mortar

Wall-/Floor-, seal thickness and implementation variants see page 17

Outside-Ø [mm]	Thickness PEF-insulation [mm]	Wall thickness [mm]	Fire protection wrap		Protective insulation		Fire resistance class	
			Width [mm]	Qty. layers [n]	Length L [mm]	Thickn. D [mm]	Wall	Floor
Multilayer pipes „HENCO STANDARD“			-		„Lamella mat“		EI 120 U/C	EI 120 U/C
≤ 12 mm	-	1,6			≥ 250	≥ 20		
≤ 32 mm		3,0				≥ 30		
≤ 63 mm		4,5						
Multilayer pipes „HENCO STANDARD“ with PE-foam insulation			PYRO-SAFE® DG-CR BS		„Lamella mat“		EI 120 U/C	EI 120 U/C
≤ 14 mm	6	2,0	100 (50 Inside seal/ 50 Outside seal)	1 (25 mm Overlapping)	≥ 250	≥ 20		
≤ 26 mm	6 - 13	3,0						
≤ 32 mm	6 - 10	2,0						

PYRO-SAFE® Novasit BM





6.7 Non-combustible pipes

6.7.1 Section insulation made of lamella mat „KLIMAROCK“ or mineral fibre shell „Conlit 150U“

- Insulation made of mineral fibre mats, for example, must be applied on non-combustible pipes. Depending on the pipe's wall thickness and outside diameter, an additional protection insulation made of mineral fibre mats can be necessary.
- The Insulation must be fixed on the pipe with straps or wire.
- In floor installations, the insulation "lamella mat" shall be secured from slipping with additional wire mesh hooks.
- Non-combustible pipes with insulation made of mineral fibre mats can be installed in an angle of 45° - 90° in relation to the components surface.

Measures for sealing in walls and floors

Additional protection insulation for pipes made of
steel, stainless steel, cast iron > 168.3 mm - ≤ 323.9 mm,
copper > 88.9 mm - ≤ 108.0 mm

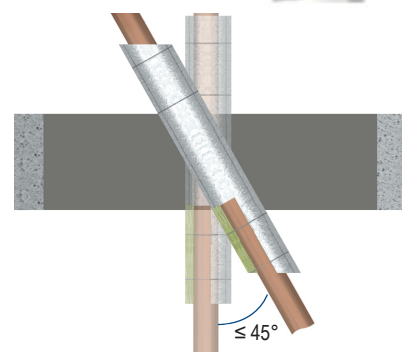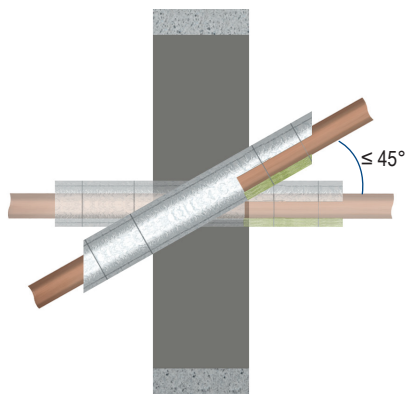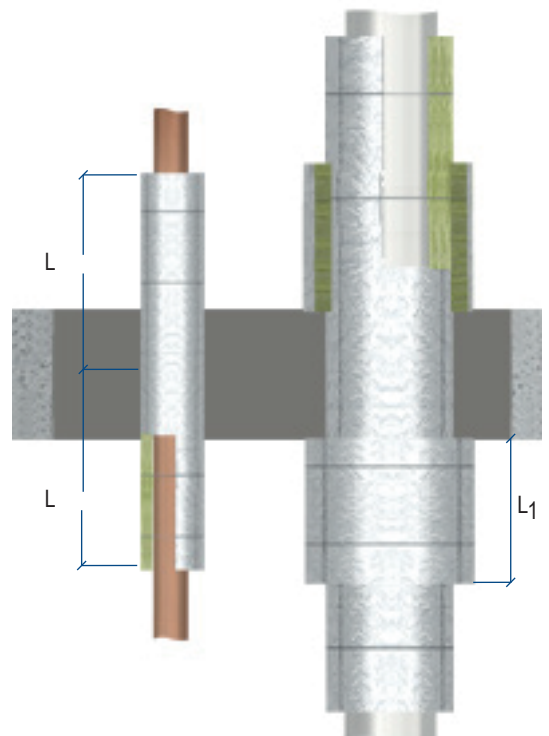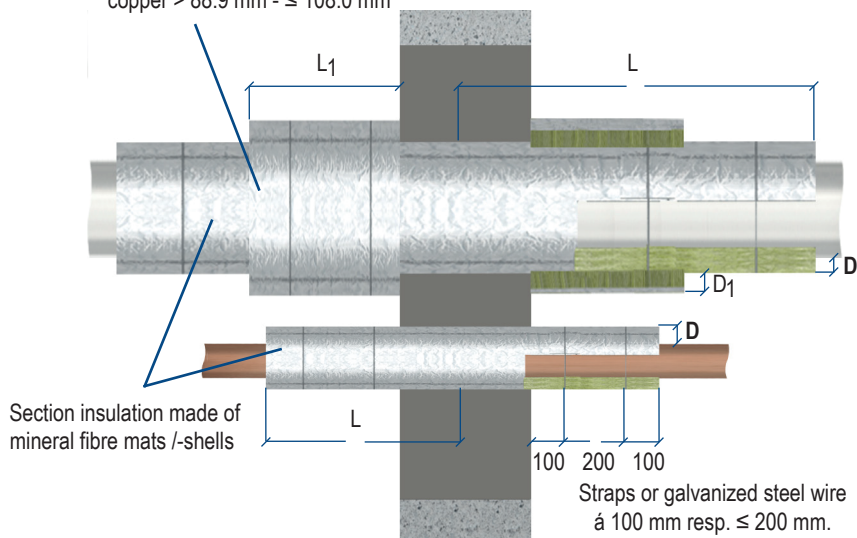

PYRO-SAFE® NOVASIT BM fire protection mortar
Wall-/Floor-, seal thickness and implementation variants see page 17

Dimension in mm



PYRO-SAFE® Novasit BM

Measures for penetration seals with lamella mat „Klimarock“

Pipe material	Outside pipe-Ø [mm]	Length L [mm]	Thickness D [mm]	Fire resistance class			
				Wall	Floor		
Copper	Ø ≤ 15,0	≥ 250	≥ 20	EI 120 C/U	EI 120 C/U		
	Ø > 15,0 - ≤ 28,0	≥ 500	≥ 20		EI 120 C/U		
	Ø > 28,0 - ≤ 42,0		≥ 30				
	Ø > 42,0 - ≤ 54,0		≥ 40				
	Ø > 54,0 - ≤ 88,9	≥ 750	≥ 60				
	Ø > 88,9 - ≤ 108,0*	≥ 1000	≥ 30				
Steel, stainless steel, cast iron	Ø ≤ 15,0	≥ 250	≥ 20			EI 120 C/U	EI 120 C/U
	Ø > 15,0 - ≤ 28,0	≥ 500	≥ 20				
	Ø > 28,0 - ≤ 42,0		≥ 30				
	Ø > 42,0 - ≤ 114,3		≥ 1000				
	Ø > 114,3 - ≤ 168,3						
	Ø > 168,3 - ≤ 323,9*						

* Additional protective insulation made of mineral fibre mat (L1 ≥ 500 mm x D1 ≥ 30 mm)

Measures for penetration seals with mineral fibre shells „Conlit 150U“

Pipe material	Outside pipe-Ø [mm]	Length L [mm]	Thickness D [mm]	Fire resistance class		
				Wall	Floor	
Copper	Ø ≤ 15,0	≥ 250	≥ 22,5	EI 120 C/U	EI 120 C/U	
	Ø > 15,0 - ≤ 28,0		≥ 26		-	
	Ø > 15,0 - ≤ 42,0		≥ 19	-	EI 120 C/U	
	Ø > 28,0 - ≤ 54,0		≥ 38	EI 120 C/U		
	Ø > 54,0 - ≤ 108,0	≥ 1000	≥ 38			
	Ø ≤ 15,0	≥ 250	≥ 22,5			EI 120 C/U
Steel, stainless steel, cast iron	Ø > 15,0 - ≤ 28,0	≥ 500	≥ 26	-	EI 120 C/U	
	Ø > 15,0 - ≤ 42,0		≥ 19			
	Ø > 28,0 - ≤ 54,0		≥ 38			
	Ø > 54,0 - ≤ 114,3	≥ 750	≥ 33	EI 120 C/U		
	Ø > 114,3 - ≤ 168,3	≥ 1000	≥ 40			
	Ø > 168,3 - ≤ 323,9*				EI 90 / E 120 C/U	



* Additional protective insulation made of mineral fibre mat (L1 ≥ 500 mm x D1 ≥ 40 mm)

PYRO-SAFE® Novasit BM

6.7.2 Section insulation made of FEF „Armaflex Protect“

- Non-combustible pipes with insulation made of FEF „Armaflex Protect“ possibly have to set up with an additional protection insulation made of mineral fibre mats, depending on the pipe's wall thickness and outside diameter.
- The protection insulation must be fixed on the pipe with straps or wires.
- In floor installations, the protection insulation shall be secured from slipping with additional wire mesh hooks.

Measures for sealing in walls and floors with section insulation „Armaflex Protect“

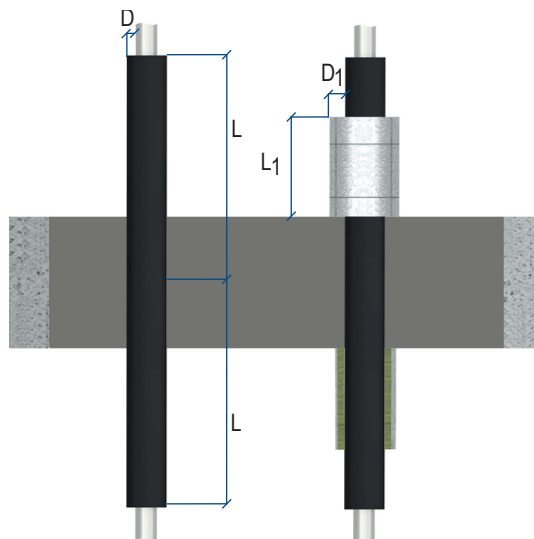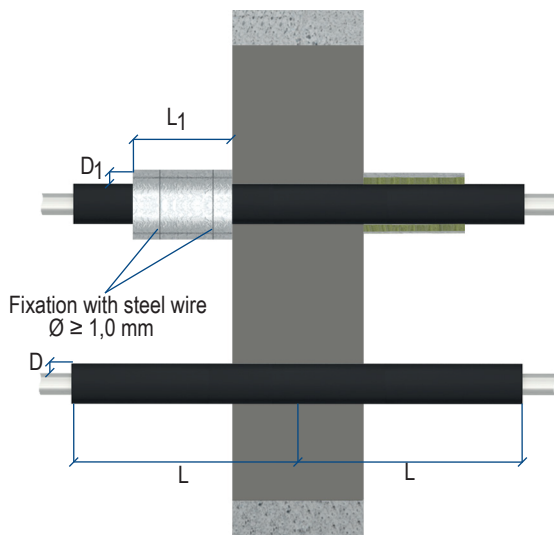

PYRO-SAFE® NOVASIT BM fire protection mortar
Wall-/Floor-, seal thickness and implementation variants see page 17

Dimension in mm

Measures for penetration seals with FEF-insulation „Armaflex Protect“

Pipe material	Outside pipe-Ø [mm]	Length L [mm]	Thickness D [mm]	Fire resistance class			
				Wall	Floor		
Copper	Ø ≤ 28,0	≥ 250	25	EI 120 C/U	EI 120 C/U		
	Ø ≤ 28,0	≥ 500	26 - 51				
	Ø > 28,0 - ≤ 88,9		25				
	Ø >28,0 - ≤ 88,9	≥ 1000	26 - 51				
	Ø >88,9 - ≤ 108,0*		26 - 52				
Steel, stainless steel, cast iron	Ø ≤ 28,0	≥ 250	25			EI 120 C/U	EI 120 C/U
	Ø ≤ 28,0	≥ 500	26 - 51				
	Ø >28,0 - ≤ 88,9		25				
	Ø >28,0 - ≤ 88,9	≥ 1000	26 - 51				
	Ø >88,9 - ≤ 170,0		52		-		
	Ø >88,9 - ≤ 170,0*		26 - 52	EI 120 C/U			



*Additional protective insulation made of mineral fibre mat (L1 ≥ 500 mm x D1 ≥ 40 mm)

PYRO-SAFE® Novasit BM

6.7.3 Section insulation made of FEF „NH/Armaflex“

- Non-combustible pipes with insulation made of FEF „NH/Armaflex“ possibly have to set up with an additional protection insulation made of mineral fibre mats, depending on the pipe's wall thickness and outside diameter.
- The protection insulation must be fixed on the pipe with straps or wires.
- In floor installations, the protection insulation shall be secured from slipping with additional wire mesh hooks.

Measures for sealing in walls and floors with section insulation „NH/Armaflex“

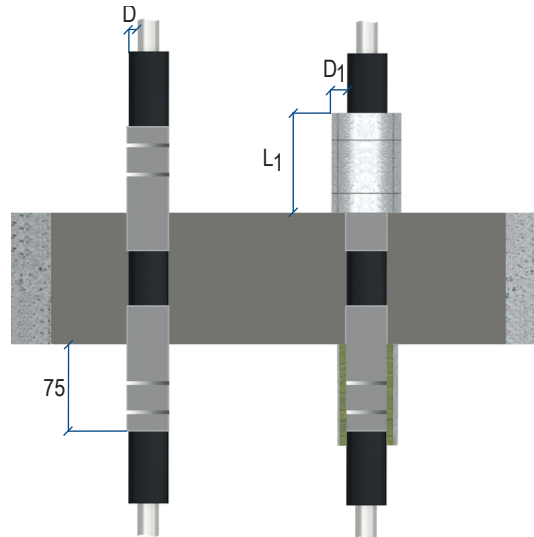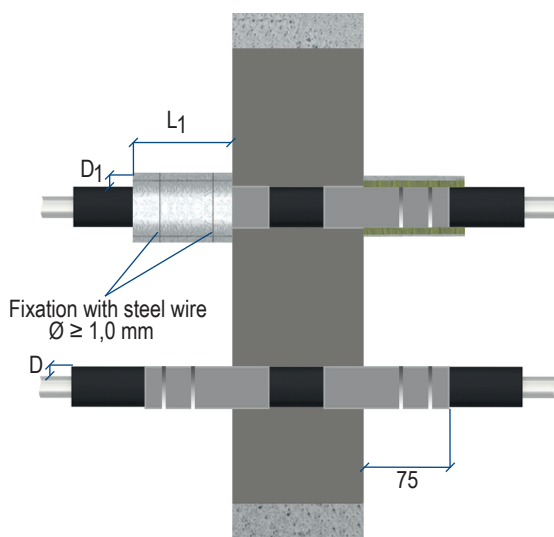

PYRO-SAFE® NOVASIT BM fire protection mortar
Wall-/Floor-, seal thickness and implementation variants see page 17

Dimension in mm

Measures for penetration seals with FEF-insulation „NH/Armaflex“

Material	Pipe- Outside-Ø [mm]	Insulation thickness D [mm]	Fire protection wrap PYRO-SAFE® DG-CR 1.5						Fire resistance class	
			Wrap width [mm]	Qty. wraps [n]	Qty. layers [n]	Overlapping [mm]	Inside seal [mm]	Outside seal [mm]	Wall	Floor
Copper	Ø ≤ 28,0	9 - 25	125	2	2	0	50	75	EI 120 C/U	EI 120 C/U
	Ø ≤ 42,0	10 - 44								
	Ø ≤ 54,0	13 - 50								
	Ø ≤ 76,0	13							-	EI 90 C/U
	Ø ≤ 88,9*	14 - 50								
	Ø ≤ 108,0**	19 - 50								
Steel, stainless steel, cast iron	Ø ≤ 168,3*	19 - 50							EI 120 C/U	EI 120 C/U

* Additional protective insulation made of mineral fibre mat (L1 ≥ 500 mm x D1 ≥ 40 mm)

** Additional protective insulation made of mineral fibre mat (L1 ≥ 750 mm x D1 ≥ 40 mm)


PYRO-SAFE® Novasit BM

6.8 Further allowed services

6.8.1 HVAC split line combinations

- HVAC split line combinations “Tubolit Duo Split” (copper pipes with PE insulation, one PE-100 plastic pipe and two accompanying cables) must be arranged vertically to the component surface.
- HVAC split line combinations must be wrapped on both side with the fire protection wrap PYRO-SAFE® DG-CR 1.5 (width 125 mm).
- The PYRO-SAFE® DG-CR 1.5 fire protection wrap is coated and covered with a protective film on one side. Before installation the protective film shall be removed, the coated side have to be inside. Fixation of the wrap with steel wires.
- The fire protection wrap (125 mm) must be arranged so that 50 mm is in the partition. The wrap must be fixed with two steel wires.

Measures for sealing in walls and floors

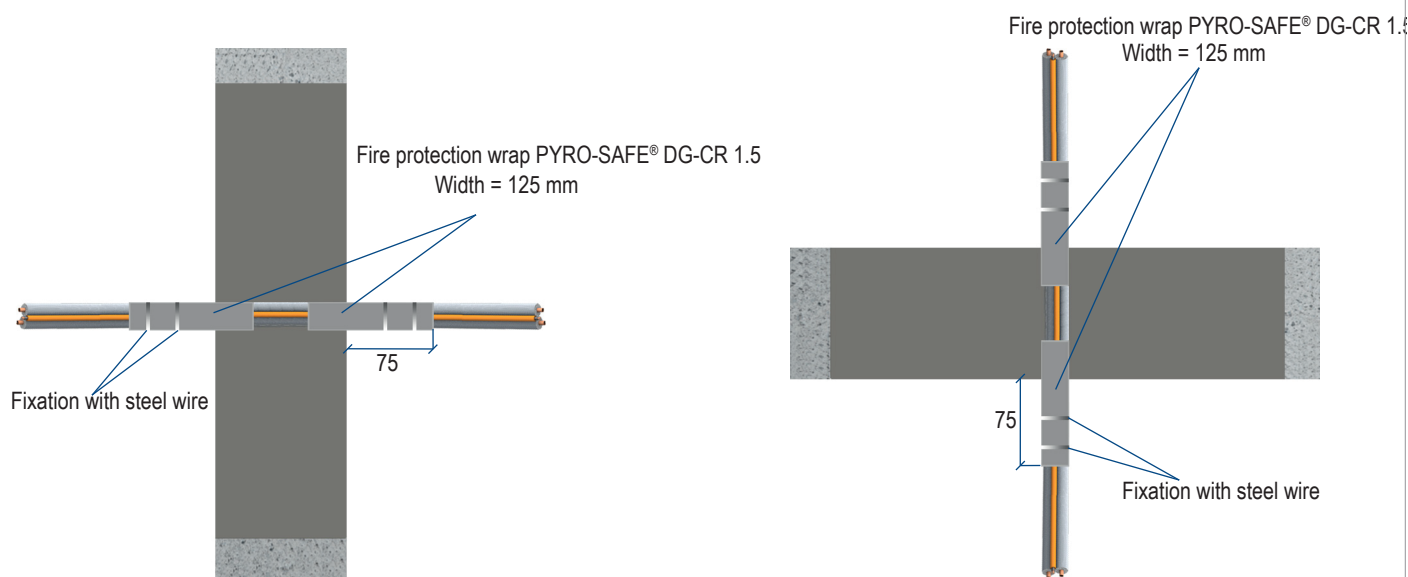

PYRO-SAFE® NOVASIT BM fire protection mortar

Wall-/Floor-, seal thickness and implementation variants see page 17

Dimension in mm

Pipe-material	Pipe-outside-Ø [mm]	Qty. add. cables Ø ≤ 14 mm [n]	Pipe-insulation [Type, mm]	PE-pipe Ø [mm]	Fire protection wrap PYRO-SAFE® DG-CR 1.5						Fire resistance class	
					Wrap width [mm]	Qty. wraps [n]	Qty. layers [n]	Overlapping [mm]	Inside seal [mm]	Outside seal [mm]	Wall	Floor
Copper	2 x ≤ 10/18	2	PEF ≤ 9,0	≤ 25	125	2	2	0	50	75	EI 120	EI 120


Fire resistance class wall/floor see page 5

PYRO-SAFE® Novasit BM

6.8.2 Double solar pipes „NanoSUN²“

- The double solar pipes must be arranged vertical to the component's surface. Pipe end configuration (U/U).
- The double solar pipes must be wrapped with the fire protection wrap PYRO-SAFE® DG-CR 1.5 (width 125 mm) on both sides. If built in floors, only one wrap is necessary above the floor.
- The PYRO-SAFE® DG-CR 1.5 fire protection wrap is coated and covered with a protective film on one side. Before installation the protective film shall be removed, the coated side have to be inside. Fixation of the wrap with steel wires.

Measures for sealing in walls and floors

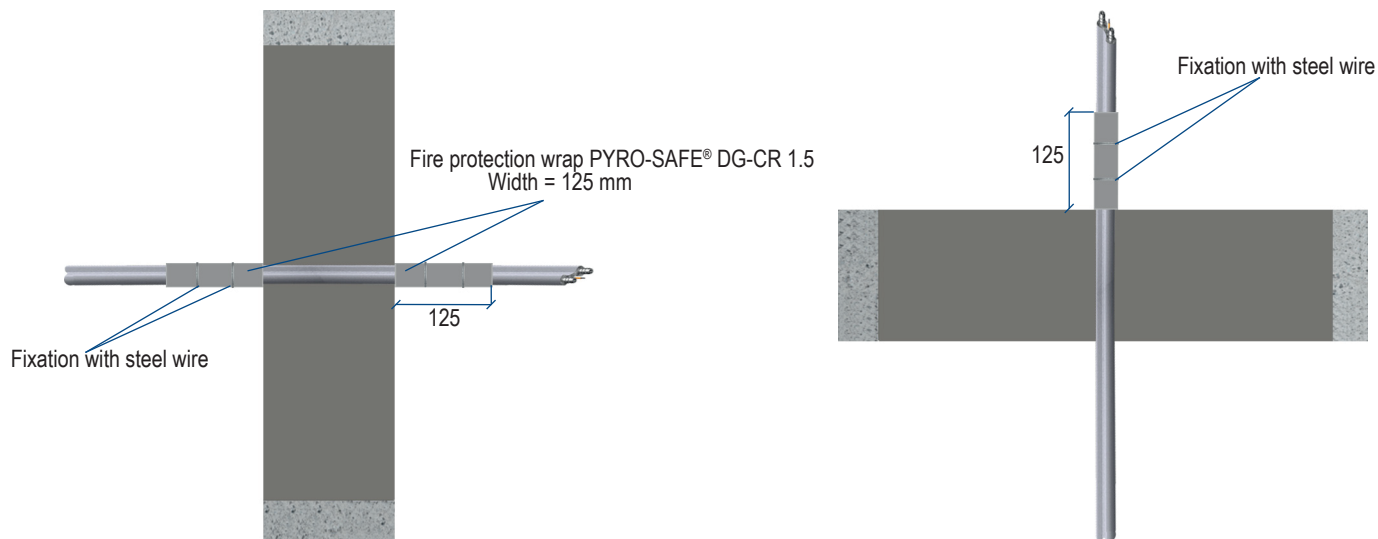

PYRO-SAFE® NOVASIT BM fire protection mortar
Wall-/Floor-, seal thickness and implementation variants see page 17

Dimension in mm


Outside pipe-Ø [mm]	Fire protection wrap PYRO-SAFE® DG-CR 1.5						Fire resistance class	
	Wrap width [mm]	Qty. wraps [n]	Qty. layers [n]	Overlapping [mm]	Inside seal [mm]	Outside seal [mm]	Wall	Floor
DN 16 - DN 25	125	2	1	≥ 40	0	125	EI 120 C/U	EI 120 C/U
		1 (above)					EI 120 C/U	EI 120 C/U

PYRO-SAFE® Novasit BM

6.8.3 “HANSA FLEX” hydraulic hoses with wire mesh insert

- The pipes must be arranged vertically to the wall/floor surface.
- The pipes must be wrapped in one layer centrally to the wall/floor axis in the partition area with the lamella mat „Klimarock“ ($L\ 1/2 \geq 250\text{ mm}$, $D \geq 20\text{ mm}$). The lamella mat then must be wrapped per side with one layer without overlapping with the PYRO-SAFE® DG-CR 1.5 fire protection wrap (width 125 mm).
- The wrap must be arranged so that 50 mm per partition side are outside of the wall/floor.
- The PYRO-SAFE® DG-CR 1.5 fire protection wrap is coated and covered with a protective film on one side. Before installation the protective film shall be removed, the coated side have to be inside. Fixation of the wrap with steel wires..

Measures for sealing in walls and floors

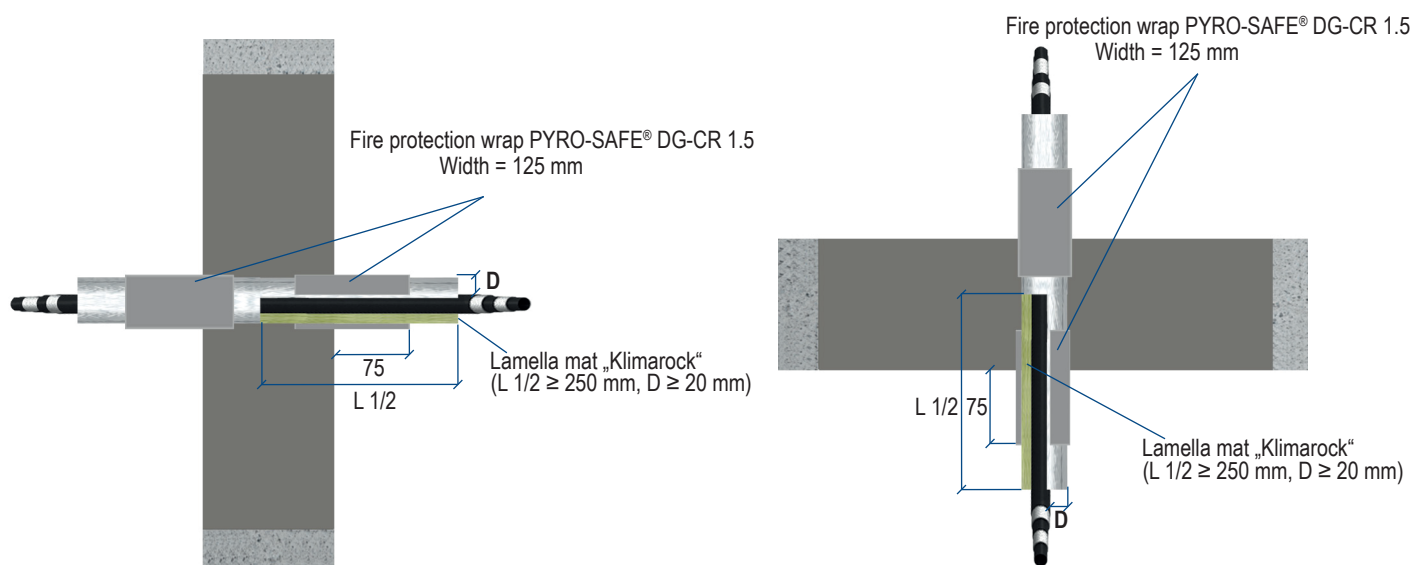

PYRO-SAFE® NOVASIT BM fire protection mortar
Wall-/Floor-, seal thickness and implementation variants see page 17

Dimension in mm


Outside pipe-Ø [mm]	Protective insulation made of lamella mat „Klimarock“		Fire protection wrap PYRO-SAFE® DG-CR 1.5						Fire resistance class	
	Length L 1/2 [mm]	Thickness D [mm]	Wrap width [mm]	Qty. wraps [n]	Qty. layers [n]	Overlapping [mm]	Inside seal [mm]	Outside seal [mm]	Wall	Floor
≤ 55,9	≥ 250 mm	≥ 20 mm	125	2	1	0	50	75	EI 120	EI 120

PYRO-SAFE® Novasit BM

6.9 Retrofitting with „PYRO-SAFE® CT“ Cable Tube

- Depending of the implemented media and wall thickness, the cable tube can be used in lengths of 150 mm, 200 mm and 300 mm can be used.
- Cables, cable bundles and conduits for electrical installation may abut one another and lie inside on the cable tube.
- The cable tube may be used for closing the openings without installations (empty seal).
- Further information and installation requirement are in the PYRO-SAFE® CT Cable Tube manual.
- For retrofitting, the existing foam plugs must be removed.
- The remaining openings between the PYRO-SAFE® CT Cable Tube and the installations or between the installations must be fully sealed with the 40 mm thick flexible foam plugs. After it must be sealed with the ablative paint PYRO-SAFE® FLAMMOTECT-A building material.
- For fire resistance classes see page 8.
- Two cable tubes á 150 mm can be put together to a cable tube with a length of 300 mm to built in floors with a thickness of ≥ 200 mm. (Connection with tape).

Retrofitting with „PYRO-SAFE® CT“ Cable Tube

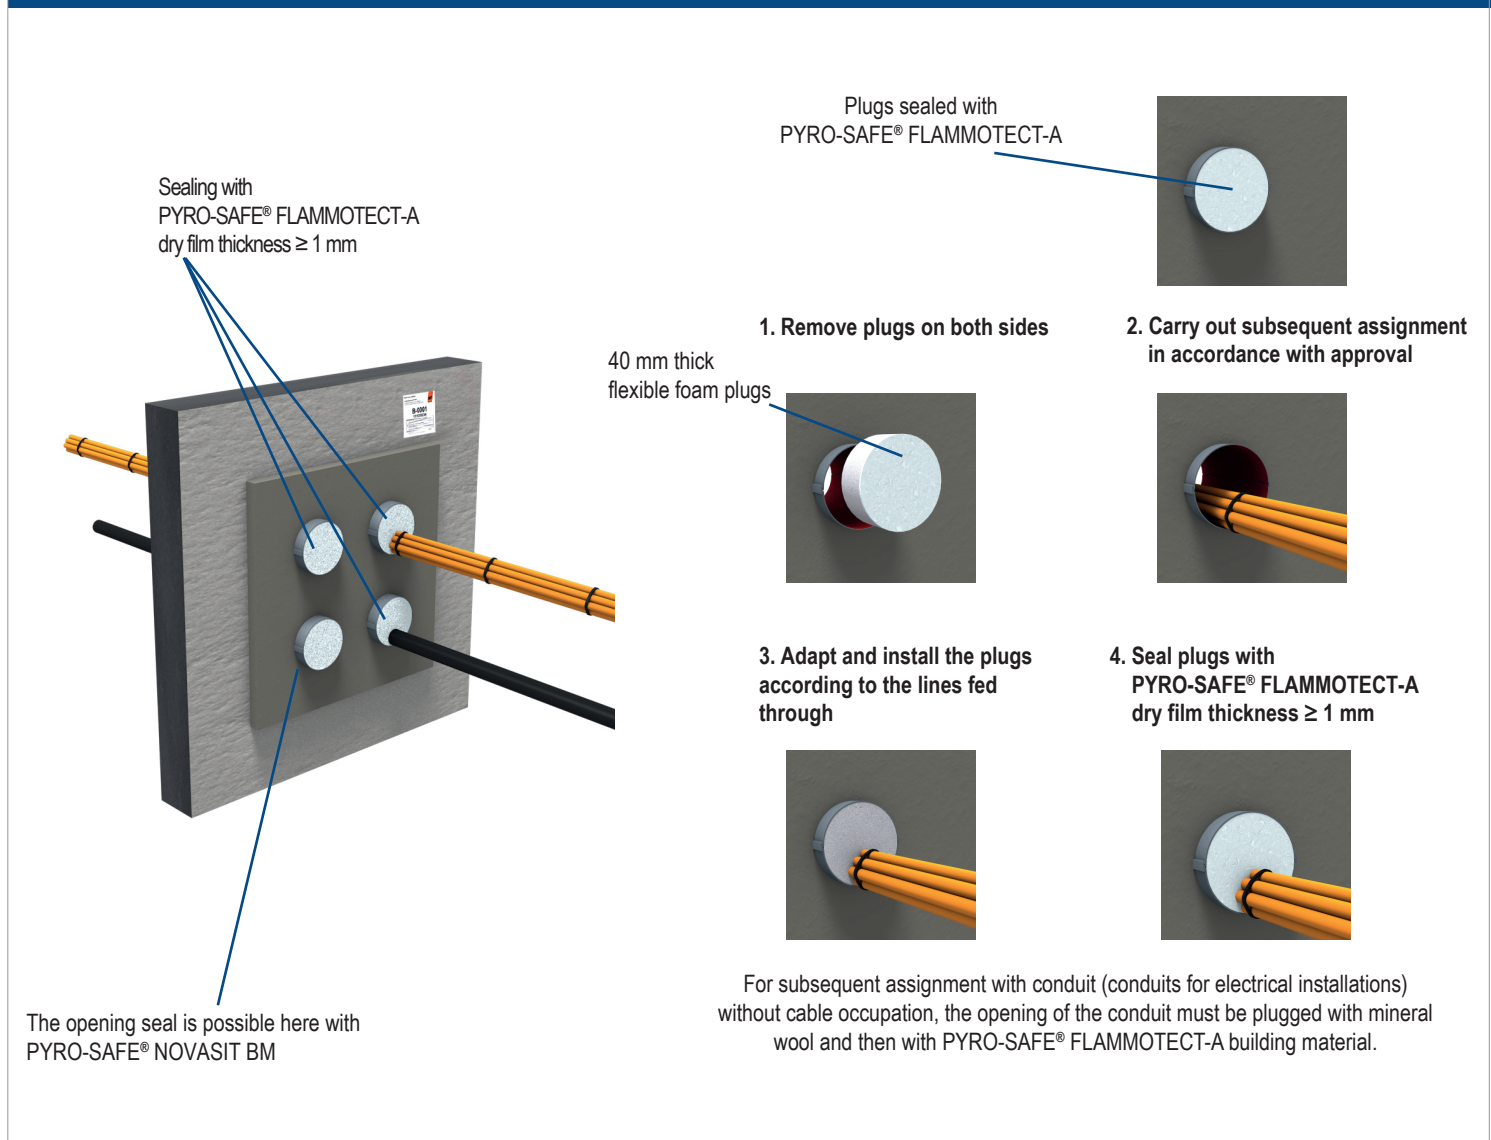

PYRO-SAFE® Novasit BM

7. Installation steps


1. Mix a PYRO-SAFE® NOVASIT BM 20 kg bag of fireproofing compound with approx. 6 litres of water. Pour water into a mixing container, add mortar. Follow the safety instructions on page 3




2. Stir to mix in thoroughly. After approx. 4-5 minutes soaking period, mix up again thoroughly.



3. If necessary, cover the floor on both sides with film, clean the recess, wet absorbing surfaces of the recess with water.

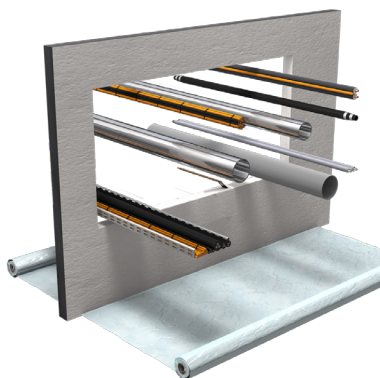


4. For additional assignment with non-combustible pipes, apply section/protective insulation, for hydraulic hoses, "HANSA-FLEX" protective insulation in accordance with overview.

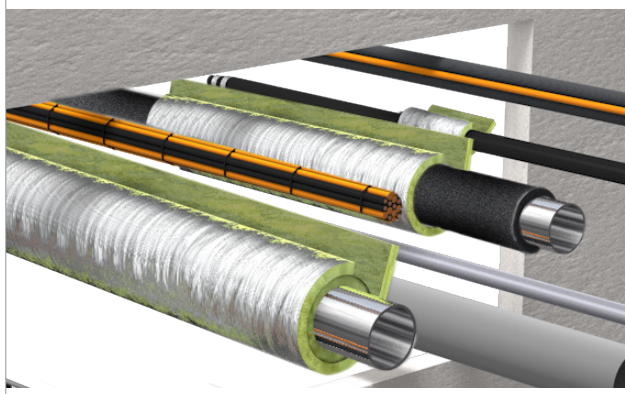


PYRO-SAFE® Novasit BM


5. For additional assignment with “NanoSUN²”, Klimasplit cables, hydraulic hoses “HANSA-FLEX” fireproof bandage PYRO-SAFE® DG-CR 1.5, wrap combustible pipes with the PYRO-SAFE® DG-CR BS fire protection wrap in accordance with overview.

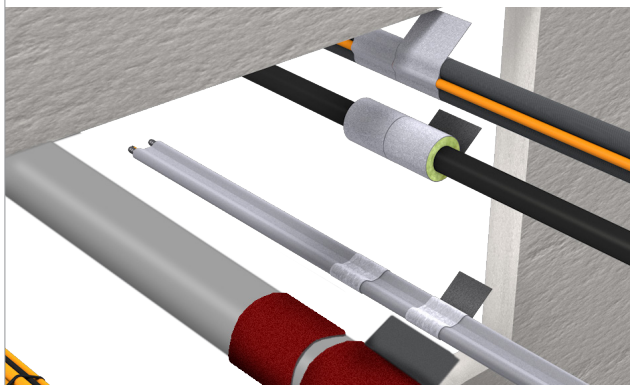


6. Apply the partition compound so that there is a solid, tight connection to the component (partition thickness min. 15 cm!). Completely fill intermediate spaces and bandage cavities.

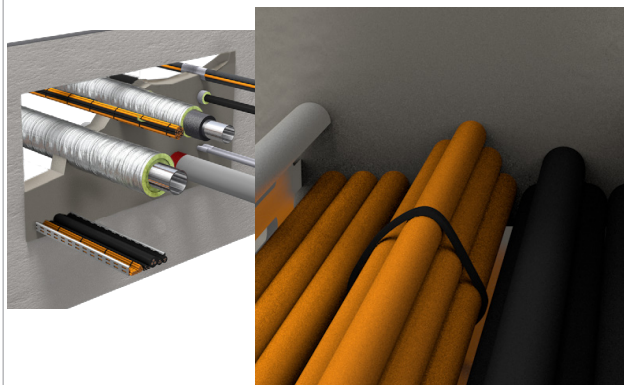

7. For additional assignment with the “PYRO-SAFE® CT” cable tube, insert in the fire protection compound and completely seal remaining openings while observing the distances. Then seal the plugs of the cable tubes with PYRO-SAFE® FLAMMOTECT-A.

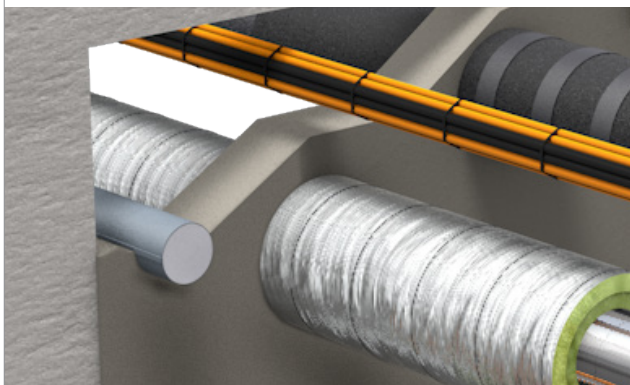


8. After appropriate hardening, smooth the surfaces with the trowel and fully rework any shrinkage cracks. The same applies to the areas after removing the formwork.

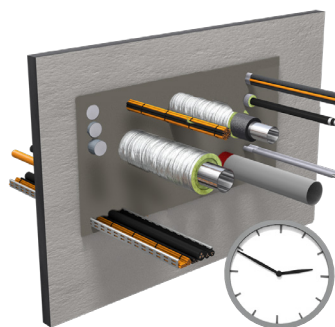

9. If required or mandatory, fill the identification label and apply on the side or below (not on!) the installation.



10. After the mortar residues dry, remove them from cables, walls and floors, clean surfaces including the removal of the cover films and dispose of properly.

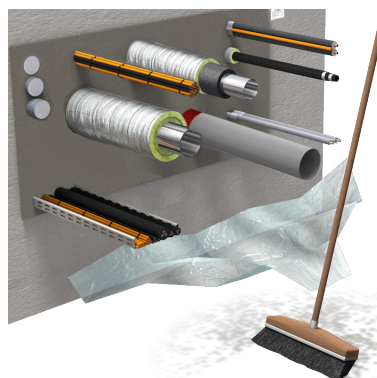



Declaration of Performance

No. 01161000-NOVASIT-BM
PYRO-SAFE® NOVASIT BM

Date: 25.09.2018
Rev.: 04
Page 1 / 1

Unique identification code of the product type

PYRO-SAFE® NOVASIT BM

Intended use

Product for use in penetration seals

Manufacturer

svt Brandschutz Vertriebsgesellschaft mbH International,
Gluesinger Strasse 86, D - 21217 Seevetal

System for assessing and verifying constancy of performance

System 1

European Assessment Document

ETAG 026-2:2011

European Technical Assessment

ETA-16/0132 vom 16.01.2017

Certificate of constancy of performance

0761-CPR-0582

Technical Assessment Body

Deutsches Institut für Bautechnik (DIBt), Berlin

The notified body

Civil Engineering Materials Testing Institute (MPA BS) in Braunschweig, code number 0761

Declared performance

Essential characteristics	Performance	Harmonised technical specifications
Reaction to fire	A1	EN 13501-1
Pressure resistance	M 2,5	EN 998-2:2010
Gross density (dry mortar)	900 kg/(m ³)	
Starting shear strength (Adhesive shear strength)	0,15 N/(mm ²) (table value)	
Water absorption	NPD	
Chloride content	≤ 0,10 M.-%	
Water vapor permeability μ	5/20 (table value)	
Thermal conductivity λ 10,dry	≤ 0,25 W/(mK) for P=50% ≤ 0,27 W/(mK) for P=90% (table values acc. EN 1745)	
Emission of dangerous substances	No dangerous substances	ETAG 026-2
Durability and serviceability	Use category type Z2	EOTA TR 024
Fire resistance	Depending on the type of installation, the type of building element and the penetrating services – see ETA-16/0132	EN 13501-2

The performance of the product identified above is in conformity with the set of declared performances.

This declaration of performance is issued, in accordance with Regulation (EU) No. 305/2011, under the sole responsibility of the manufacturer identified above. DoP online available at www.svt.de

Signed for and on behalf of the manufacturer by:

p.p. Christian Meyer-Korte
Head of Product Management / Private Label

p.p. Andree Schober
Head of chemical department



Fire protection worldwide



svt Brandschutz Vertriebsgesellschaft mbH International

Glüsinger Str. 86 • 21217 Seevetal

Phone +49 4105 40 90 0 • Fax +49 4105 40 90 32

international.svt.de • global@svt.de

